

TRENCH AND BACKFILL NOTES:


1. ADEQUATE BARRICADES & WARNING SIGNS SHALL BE ERECTED BEFORE ANY WORK IS STARTED IN PUBLIC RIGHT-OF-WAY.
2. THE ROADWAY SHALL BE CUT ONLY WHERE REQUIRED.
3. NO MORE THAN HALF OF THE WIDTH OF THE ROAD SHALL BE CUT & OPENED AT ONE TIME.
4. REFER TO SPECIFICATIONS FOR ANY SPECIAL REQUIREMENTS OR CONDITIONS
5. BACKFILL SHALL BE COMPLETED IMMEDIATELY AFTER PIPELINE LAYING WITHIN PUBLIC RIGHT-OF-WAYS OR CROSSING PUBLIC RIGHT-OF-WAYS & PRIVATE DRIVEWAYS.
6. THE EXISTING PAVING SURFACE SHALL BE SAW CUT IN A STRAIGHT LINE A MINIMUM OF 12" WIDER THAN UNDISTURBED SIDE OF THE TRENCH ASYMMETRICAL ABOVE THE CENTER LINE OF THE EXCAVATION.
7. ANY CONCRETE PAVING SHALL BE SAW CUT 6" WIDER THAN UNDISTURBED SIDES OF THE EXCAVATION.
8. LOCAL STREETS SHALL BE 10" AND MAJOR/MINOR STREETS SHALL BE 12" THICK. BASE MATERIAL SHALL BE PLACED 2' WIDER THAN TRENCH WIDTH ON BOTH SIDES. FLEXIBLE BASE SHALL BE TXDOT ITEM 247 TYPE A, GRADE 1.
9. DAMAGED PAVEMENT OUTSIDE THE TRENCH CUT SHALL BE REMOVED AND REPLACED WITH A BASE. THICKNESS OF 10" OR A THICKNESS MATCHING EXISTING, WHICHEVER IS GREATER, AT NO ADDITIONAL COST TO THE OWNER.
10. REPLACEMENT AC SURFACE LAYER SHALL BE OF THE TYPE AND THICKNESS BASED ON FUNCTIONAL CLASSIFICATION.
 - A. MIN. 2" HMAC SHALL BE TXDOT ITEM 340, TYPE D FOR TRENCH REPAIR IN LOCAL/RESIDENTIAL STREETS AND DRIVEWAYS.
 - B. MIN. 3" HMAC SHALL BE TXDOT ITEM 340, TYPE D FOR TRENCH REPAIR IN COLLECTION/ARTERIAL STREETS.

TRENCH SAFETY NOTES


1. TRENCH SAFETY SYSTEM, SHORING OR SIDE SLOPE TO BE IN ACCORDANCE WITH OSHA STANDARDS.
2. TRENCH SAFETY SYSTEM PLAN TO BE PROVIDED BY CONTRACTOR PRIOR TO CONSTRUCTION.

NOT TO SCALE

PROPERTY OF 	ASPHALT PAVEMENT AND DRIVEWAY (TRENCH REPAIR)	 M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			OCTOBER 2018	OCTOBER 2018
			SHEET	
		1 OF 1		

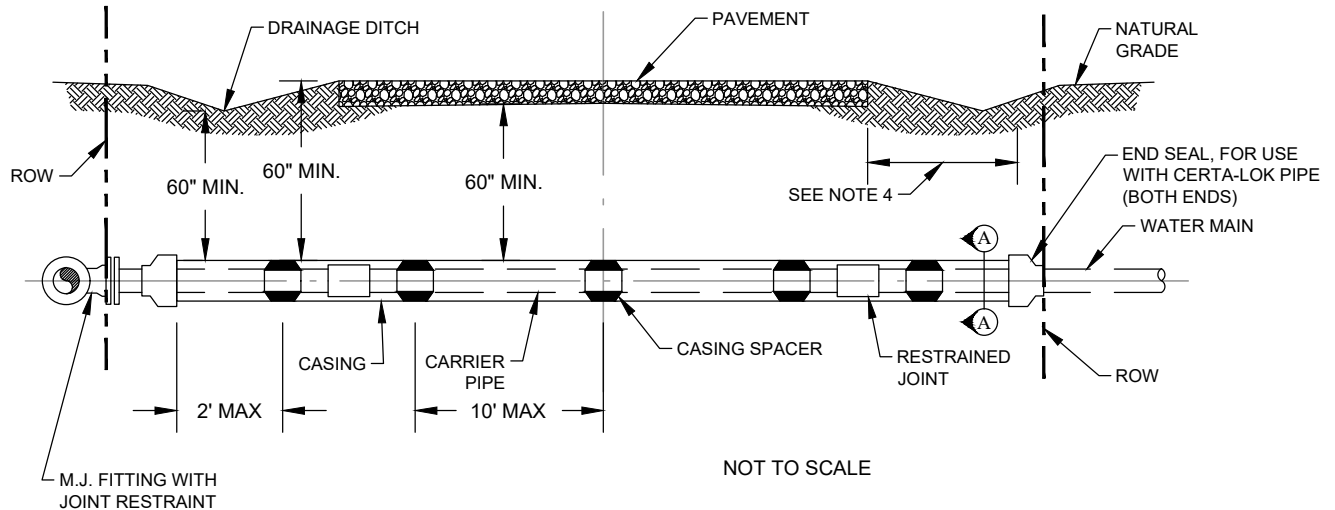

NOT TO SCALE

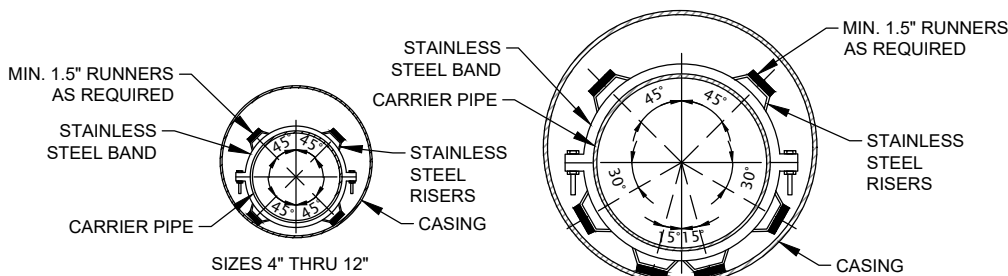


SECTION A-A SIZE 16"

Carrier Pipe (DR 18)	Casing Size	Steel Casing (0.375 IN Wall)	PVC Casing (DR 25)	HDPE Casing (DR 21)	Casing Spacers	
Nominal Size (IN)	Inside Diameter (IN)				Min. Band Width (IN)	No. of Runners Per Tie
4	16	15.25	15.92	13.755	7	2 TOP, 2 BOTTOM
6	16	15.25	15.92	15.643	7	2 TOP, 2 BOTTOM
8	24	23.25	23.61	19.419	7	2 TOP, 2 BOTTOM
12	24	23.25	23.61	23.195	7	2 TOP, 2 BOTTOM
16	30	29.25	29.29	28.769	7	2 TOP, 4 BOTTOM


NOTES:

- POLYVINYL CHLORIDE (PVC) CARRIER PIPE THAT IS 4-INCH IN DIAMETER SHALL BE C900 DR 18, FULLY RESTRAINED THROUGH THE CASING. POLYVINYL CHLORIDE (PVC) CARRIER PIPE SHALL BE CERTA-LOK C900/RJIB (DR 18) FOR 6-INCH TO 12-INCH AND CERTA-LOK C905/RJ (OR APPROVED EQUAL) FOR 16-INCH TO 24-INCH PIPE DIAMETERS.
- STEEL CASING SHALL BE STANDARD WEIGHT OR HEAVIER PIPE CONFORMING TO ASTM A-36, ASTM A-568, ASTM A-135, ASTM A-139 OR OTHER ACCEPTABLE STANDARD SPECIFICATION. PIPE JOINTS SHALL BE WELDED IN ACCORDANCE WITH AWWA C-206. HDPE CASING MAY BE USED IN LIEU OF STEEL CASING PER FIGURE: 43 TAC §21.40(a)(2)(A).
- SUBSEQUENT CASING SPACERS ARE REQUIRED FOR 4" TO 14" PIPE SIZES TO BE AT 10 FEET APART AND FOR 16" TO 30" PIPE SIZES TO BE AT 8 FEET APART WITHIN THE CASING WITH AT LEAST 3 SPACERS PER JOINT ON PIPE. ONE CASING SPACER SHALL BE REPLACED WITHIN 2 FEET OF ENDS OF CASING FOR ALL PIPE SIZES.
- LENGTHS OF ENCASEMENT SHALL BE PER TAC §21.40(a)(2)(A). THE LENGTHS OF ANY ENCASEMENT SHALL EXTEND, AS APPLICABLE, TO WITHIN 5 FEET OF THE RIGHT OF WAY, TWO FEET OF A CONNECTING LONGITUDINAL LINE, OR FIVE FEET BEYOND THE FACE OF THE CURB, WHICHEVER IS GREATEST. THESE LENGTHS OF ENCASEMENT INCLUDE AREAS UNDER CENTER MEDIANS AND OUTER SEPARATIONS.
- CASING SPACERS SHALL BE MADE FROM T-304 STAINLESS STEEL OF A MINIMUM 14 GAUGE THICKNESS.
- CASING SPACERS SHALL HAVE A SYNTHETIC RUBBER OR PVC LINER TO INSULATE THE PIPELINE FROM THE SPACER.
- CASING SPACERS SHALL HAVE A MIN. 1.5" WIDE GLASS REINFORCED PLASTIC OR UHMW POLYMER RUNNERS TO INSULATE THE SPACER FROM THE CASING.
- CASING END SEALS SHALL BE MADE OF 1/8" THICK NEOPRENE RUBBER AND INCLUDE 1/2" WIDE T-304 STAINLESS STEEL BANDINGS.

PROPERTY OF 	CASING DETAIL	M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			JUNE 2015	JULY 2023
SHEET			1 OF 1	

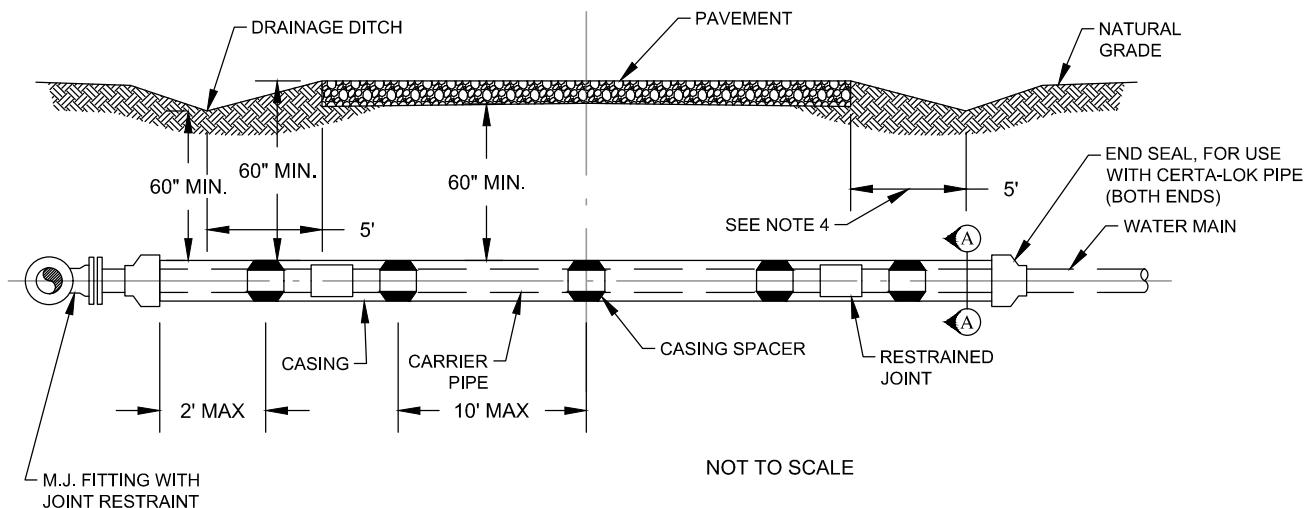

NOT TO SCALE

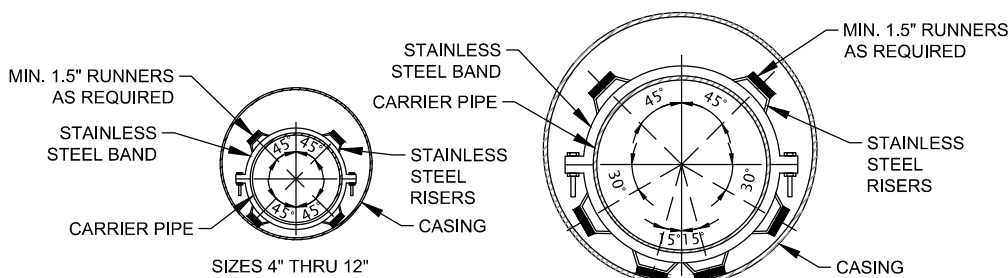


SECTION A-A SIZE 16"

Carrier Pipe (DR 18)	Casing Size	Steel Casing (0.375 IN Wall)	PVC Casing (DR 25)	HDPE Casing (DR 21)	Casing Spacers	
Nominal Size (IN)	Inside Diameter (IN)			Min. Band Width (IN)	No. of Runners Per Tie	
4	16	15.25	15.92	13.755	7	2 TOP, 2 BOTTOM
6	16	15.25	15.92	15.643	7	2 TOP, 2 BOTTOM
8	24	23.25	23.61	19.419	7	2 TOP, 2 BOTTOM
12	24	23.25	23.61	23.195	7	2 TOP, 2 BOTTOM
16	30	29.25	29.29	28.769	7	2 TOP, 4 BOTTOM

NOTES:


- CARRIER PIPE SIZES ARE BASED ON CERTA-LOK C900/RJIB FOR 4" TO 12" PIPE DIAMETER AND CERTA-LOK C905/RJ FOR 14" TO 24" PIPE DIAMETER OR APPROVED EQUAL.
- STEEL CASING SHALL BE STANDARD WEIGHT OR HEAVIER PIPE CONFORMING TO ASTM A-36, ASTM A-568, ASTM A-135, ASTM A-139 OR OTHER ACCEPTABLE STANDARD SPECIFICATION. PIPE JOINTS SHALL BE WELDED IN ACCORDANCE WITH AWWA C-206. HDPE CASING MAY BE USED IN LIEU OF STEEL CASING PER FIGURE: 43 TAC §21.40(a)(2)(A).
- SUBSEQUENT CASING SPACERS ARE REQUIRED FOR 4" TO 14" PIPE SIZES TO BE AT 10 FEET APART AND FOR 16" TO 30" PIPE SIZES TO BE AT 8 FEET APART WITHIN THE CASING WITH AT LEAST 3 SPACERS PER JOINT ON PIPE. ONE CASING SPACER SHALL BE REPLACED WITHIN 2 FEET OF ENDS OF CASING FOR ALL PIPE SIZES.
- THE LENGTHS OF ENCASEMENT SHALL EXTEND A MINIMUM OF 5 FT PAST THE EDGE OR BEYOND THE FACE OF THE CURB, WHICHEVER IS GREATEST UNLESS OTHERWISE DIRECTED BY ENGINEER OR REGULATORY AUTHORITY. THE LENGTHS OF ENCASEMENT SHALL INCLUDE AREAS UNDER CENTER MEDIANS AND OUTER SEPARATIONS.
- CASING SPACERS SHALL BE MADE FROM T-304 STAINLESS STEEL OF A MINIMUM 14 GAUGE THICKNESS.
- CASING SPACERS SHALL HAVE A SYNTHETIC RUBBER OR PVC LINER TO INSULATE THE PIPELINE FROM THE SPACER.
- CASING SPACERS SHALL HAVE A MIN. 1.5" WIDE GLASS REINFORCED PLASTIC OR UHMW POLYMER RUNNERS TO INSULATE THE SPACER FROM THE CASING.
- CASING END SEALS SHALL BE MADE OF 1/8" THICK NEOPRENE RUBBER AND INCLUDE 1/2" WIDE T-304 STAINLESS STEEL BANDINGS.

	COUNTY CASING DETAIL	M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			SEPT 2023	
SHEET			1 OF 1	

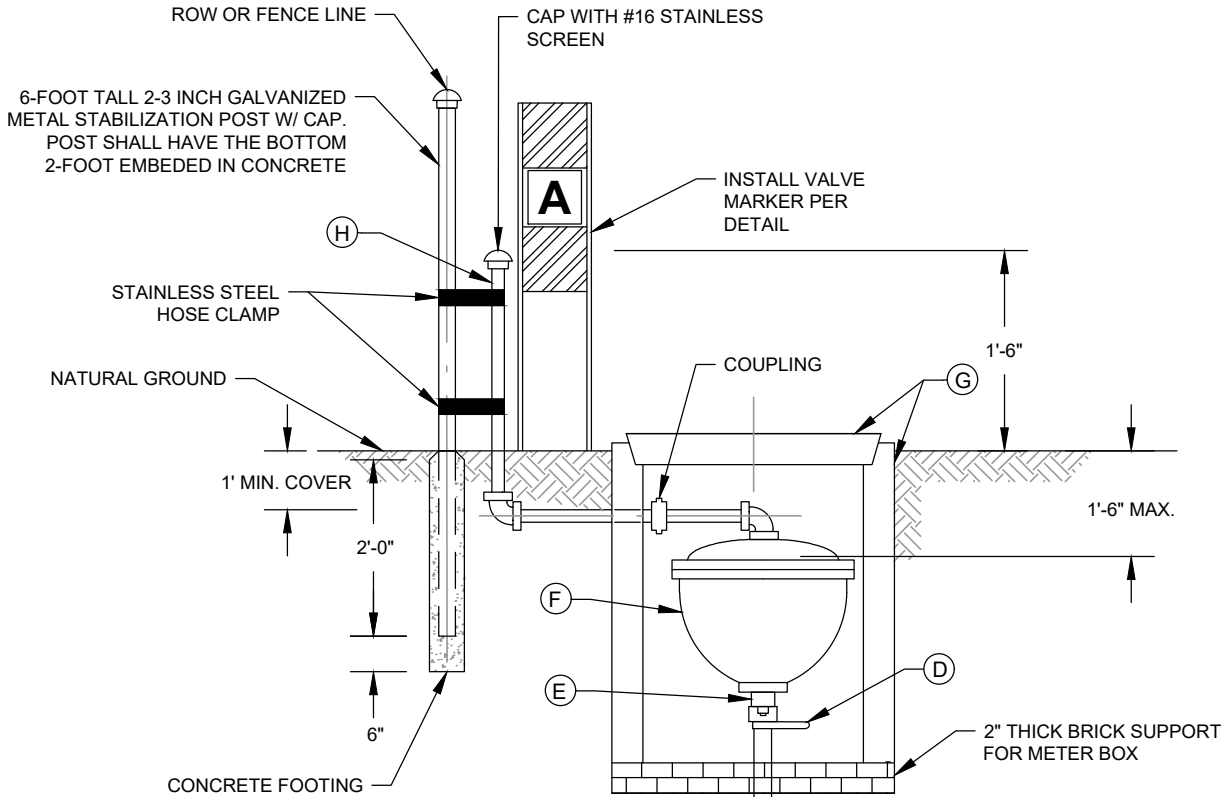

NOTES:

1. COMBINATION AIR VALVE SHALL BE SET NEXT TO FENCE AND/OR ROW LINE WITH GALVANIZED RISER PIPE AT FENCE/ROW LINE. THE RISER SHALL BE STABILIZED WITH A 6 FT TALL, 2-3 INCH GALVANIZED POST. THE STABILIZATION PIPE SHALL BE HAVE THE BOTTOM 2 FT EMBEDDED IN CONCRETE. THE RISER PIPE SHALL BE SECURED TO THE STABILIZATION POST WITH STEEL HOSE CLAMP.
2. COMBINATION AIR VALVES SHALL BE INSTALLED AT HIGH POINTS IN THE WATER MAIN (SEE PLANS).
3. SERVICE SADDLES SHALL BE SECURED WITH A MINIMUM OF THREE LAYERS CIRCUMFERENTIAL TURNS OF POLY TAPE.

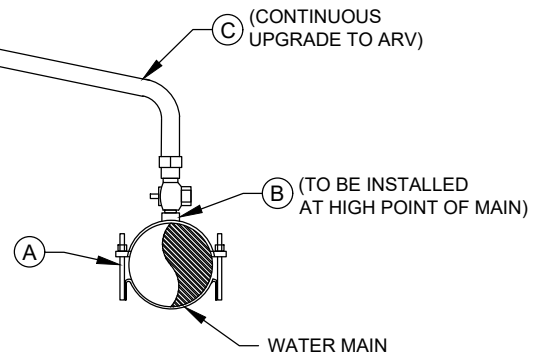

TAP MATERIAL LIST		MATERIAL LIST SIZES	
LABEL	ITEM	1-INCH TAP	2-INCH TAP
A	APPROVED TAPPING SADDLE	1"	2"
B	CORPORATION STOP	1"	2"
C	CTS SDR9 HDPE TUBING	1"	2"
D	BRASS BALL VALVE WITH LEVER	1"	2"
E	BRASS NIPPLE THREADED	1"	2"
F	COMBINATION AIR VALVE	PER AEL*	
G	METER BOX AND LID	DFW2830FD OR DFW2836FD**	
H	GALVANIZED IRON PIPE AND FITTINGS	1"	2"

* AEL = APPROVED EQUIPMENT LIST

** METER BOX TO BE INSTALLED AS NECESSARY TO COVER FULL DEPTH OF COMBINATION AIR RELEASE VALVE.

NOT TO SCALE



COMBINATION AIR VALVE DETAIL




M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446

APPROVED	REVISION
JUNE 2015	OCTOBER 2020

SHEET


1 OF 1

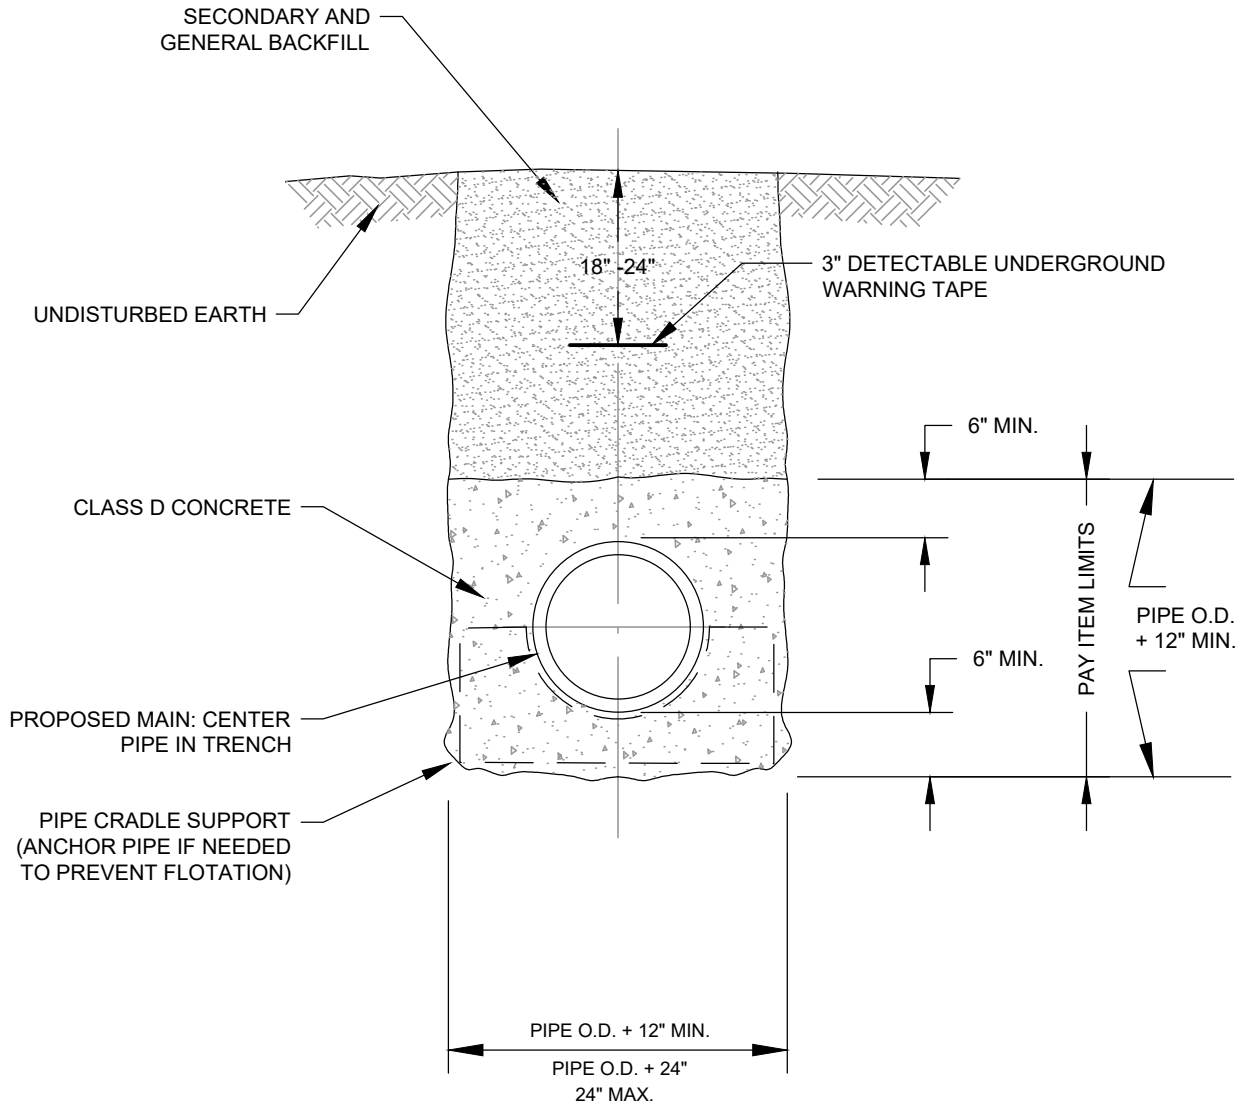

CONCRETE ENCASEMENT

NOTES:

1. ALL CONCRETE ENCASEMENT SHALL BE POURED AT A PLANE 6" ABOVE THE PIPE BETWEEN EXCAVATED TRENCH WALL.
2. CONCRETE ENCASEMENT WILL BE USED ONLY WHERE CALLED OUT IN THE PLANS AND LIMITS OF PAYMENT WILL BE PER THIS DETAIL.
3. BACKFILL AND RESTORATION WORK WILL BE PER APPROPRIATE TRENCH DETAIL WITH EMBEDMENT FOLLOWING THIS DETAIL.
4. SUPPORTS ARE SUBSIDIARY TO CONCRETE ENCASEMENT

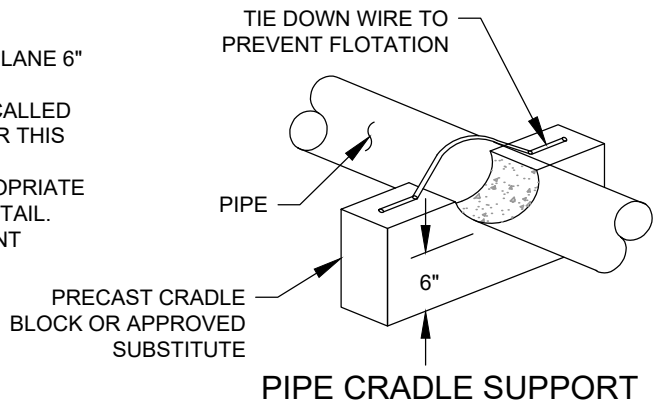

NOT TO SCALE



CONCRETE ENCASEMENT DETAIL




M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
 TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446

APPROVED	REVISION
MAY 2016	FEB 2022


SHEET

1 OF 1

PIPE DIAMETER	DOUBLE DETECTOR CHECK	BY-PASS METER	SMITH-BLAIR COUPLING
4"	4"	5/8" - 3/4"	932
6"	6"	5/8" - 3/4"	932
8"	8"	5/8" - 3/4"	932

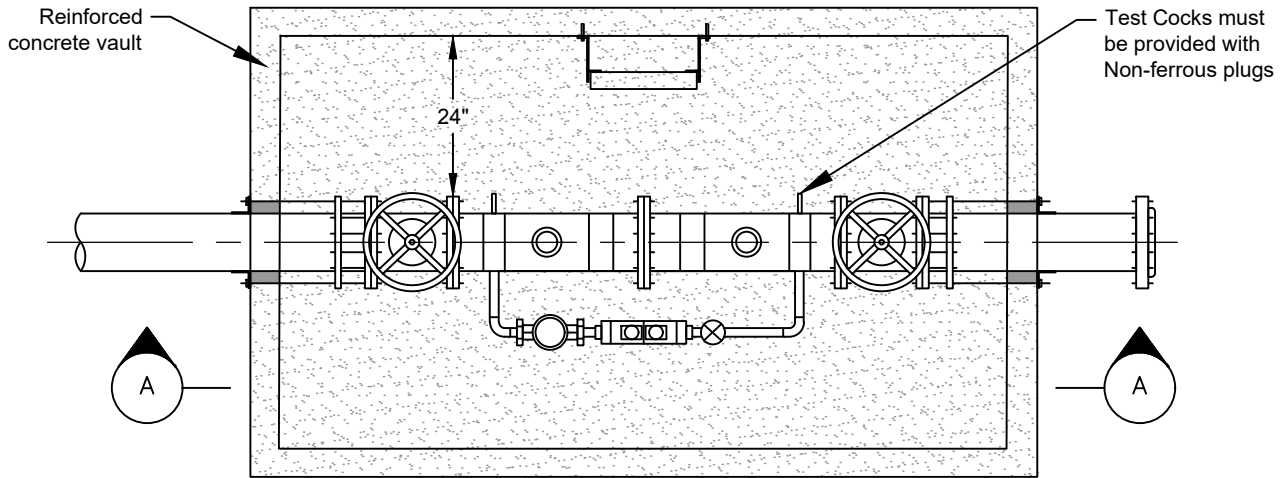

PLAN

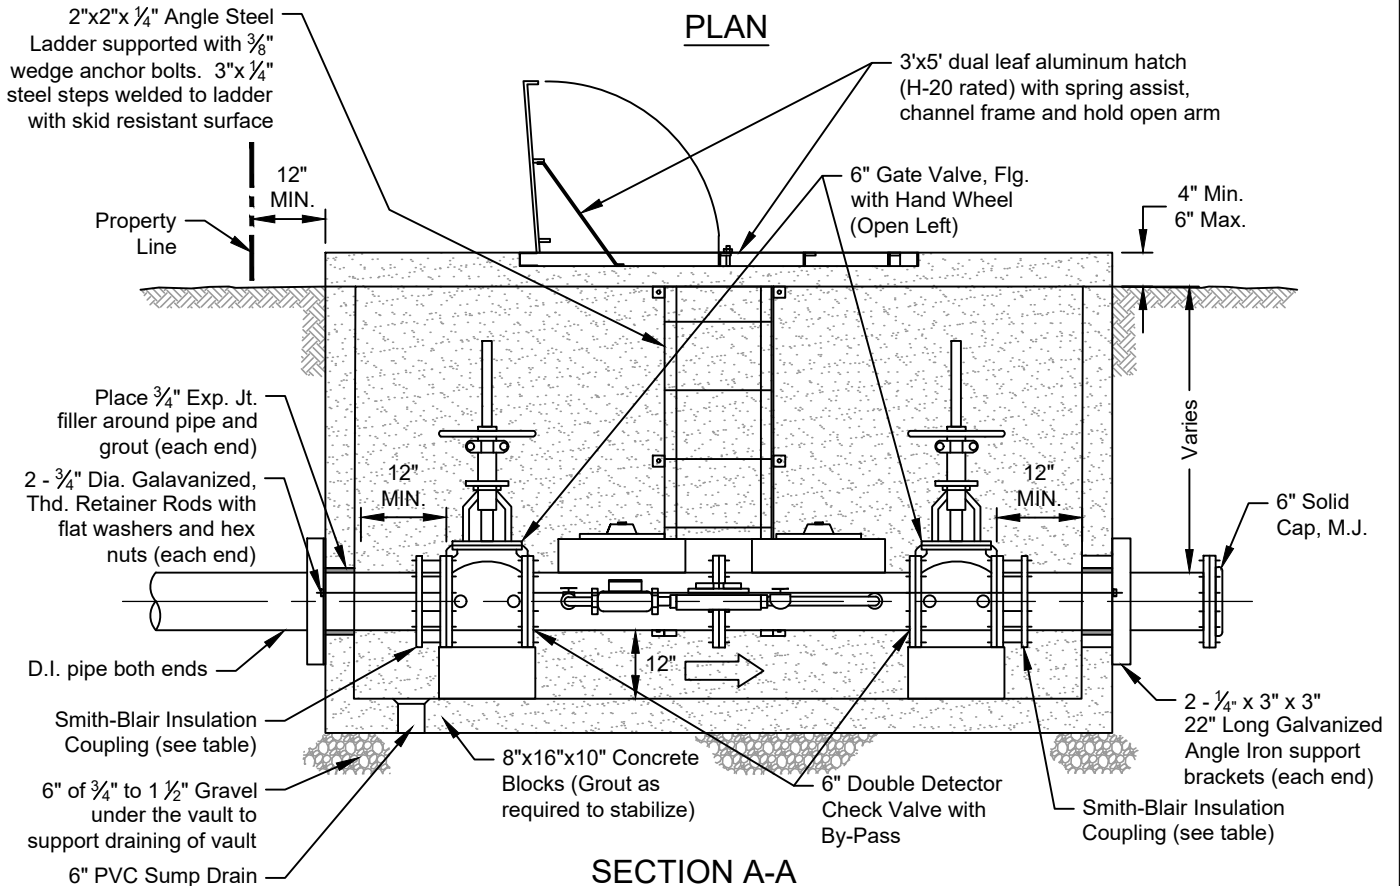

SECTION A-A
N.T.S.

NOTES:

- APPROVED ASSEMBLIES ARE REQUIRED TO HAVE RESILIENT SEATED SHUT-OFF VALVES AND TEST COCKS AS INTEGRAL PARTS OF THE ASSEMBLIES, OTHERWISE APPROVAL IS VOIDED.
- THE BYPASS METER WILL BE SUPPLIED BY CCSUD AND PAID FOR BY THE CUSTOMER.
- NO CONNECTIONS OR TEES WILL BE ALLOWED BETWEEN SERVICE CONNECTION AND ASSEMBLY.
- FOR ADDITIONAL INFORMATION, REFER TO CCSUD WATER DESIGN CRITERIA AND TECHNICAL SPECIFICATIONS.



DOUBLE CHECK DETECTOR ASSEMBLY (DCDA) DETAIL




M&S ENGINEERING
ELECTRICAL | CIVIL | MEP
TXENG FIRM # F-1394 | TBPELS FIRM #10169800
WWW.MSENGR.COM | (830) 228-5446

APPROVED REVISION

DEC 2022 JUNE 2023

SHEET

1 OF 1

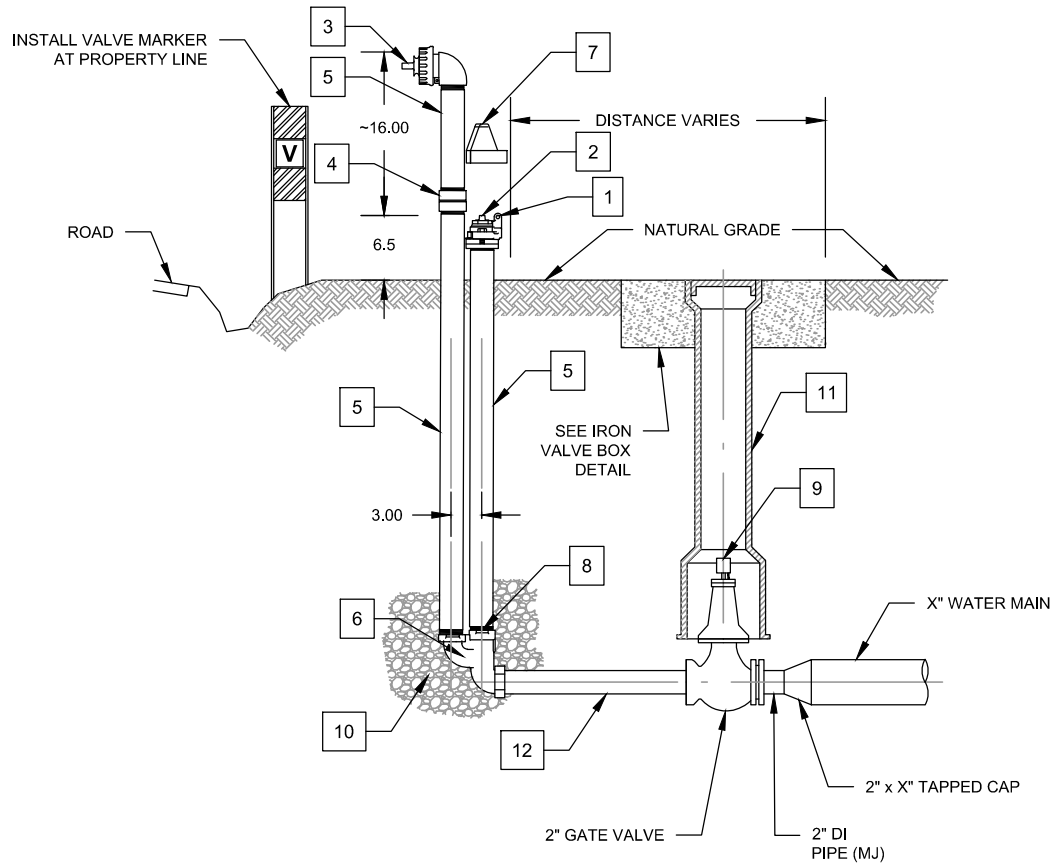


NOTE:

1. BURIED PIPING, FITTINGS, AND FITTING JOINTS SHALL BE WRAPPED IN POLYWRAP.
2. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
3. ALL PIPE JOINTS SHALL BE KEPT FREE FROM CONCRETE.
4. POLYWRAP SHALL BE SECURED WITH A MINIMUM OF THREE CIRCUMFERENTIAL TURNS OF POLY TAPE.
5. 12"x12"x4" THICK CONCRETE BLOCKS SHALL BE INSTALLED DIRECTLY UNDER ALL VALVES, FITTINGS, ETC.

ITEM	ITEM/DESCRIPTION	NOTES
1	TOP CAP	
2	SLOTTED OPERATING NUT	
3	2-1/2" NST OUTLET	SHOWN WITH CAP
4	2" COUPLING	
5	2" STEEL PIPE	
6	INLET VALVE BODY	
7	LOCKING COVER	
8	DRAIN HOLE	
9	HYDRANT SHUT-OFF VALVE	
10	CRUSHED ROCK	
11	VALVE BOX	
12	2" BRASS PIPE (LEAD FREE)	ASTM B43

NOT TO SCALE



END OF LINE PERMANENT
FLUSH VALVE DETAIL




M&S ENGINEERING
ELECTRICAL | CIVIL | MEP
TXENG FIRM # F-1394 | TBPELS FIRM #10169800
WWW.MSENGR.COM | (830) 228-5446

APPROVED REVISION

JUNE 2015 OCT 2023


SHEET

1 OF 1

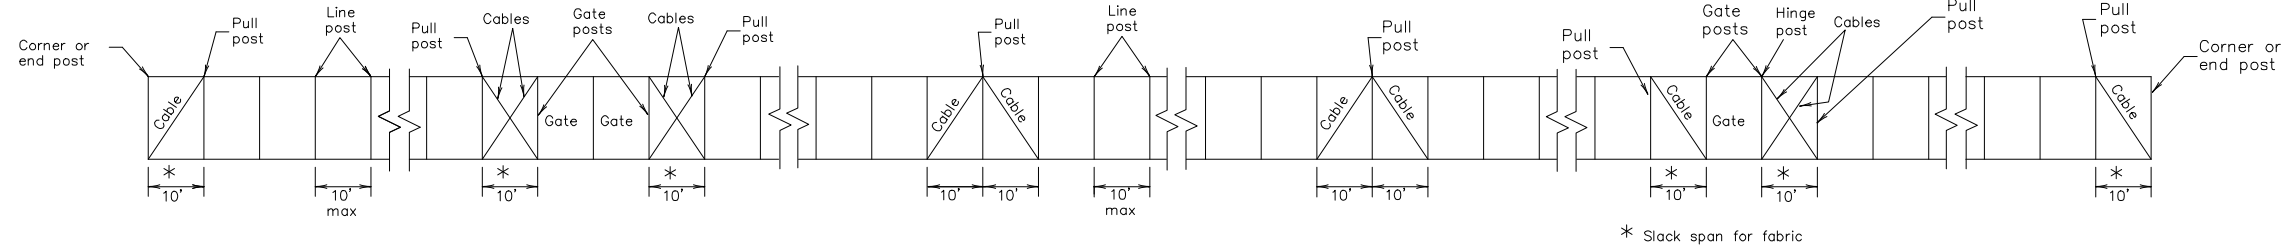


TYPICAL CABLE AND POST ARRANGEMENT

* Slack span for fabric

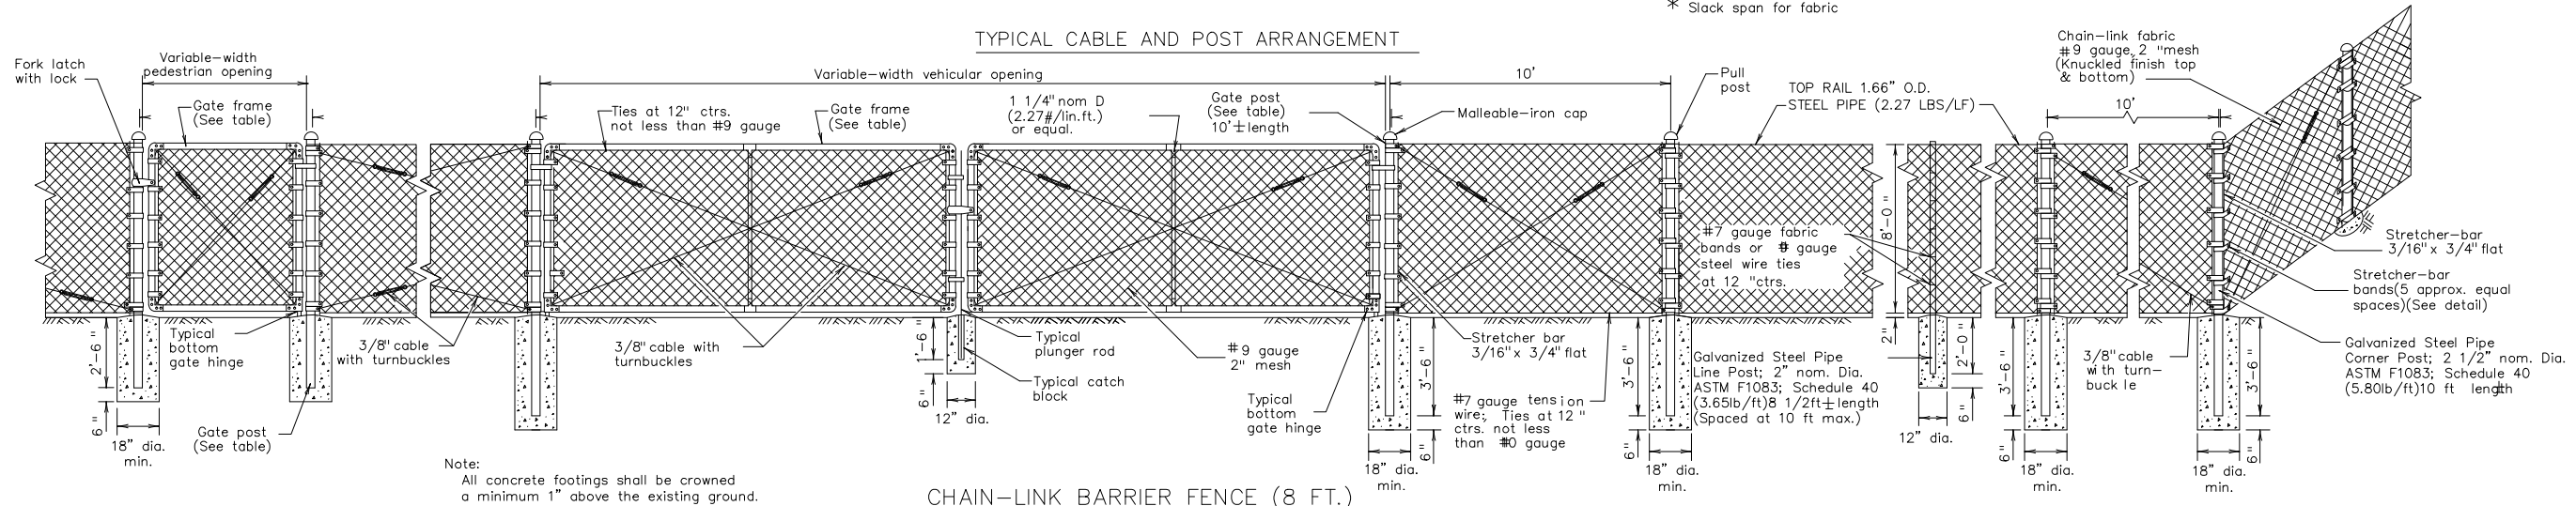


Note: All concrete footings shall be crowned a minimum 1\"/>

CHAIN-LINK BARRIER FENCE (8 FT.)

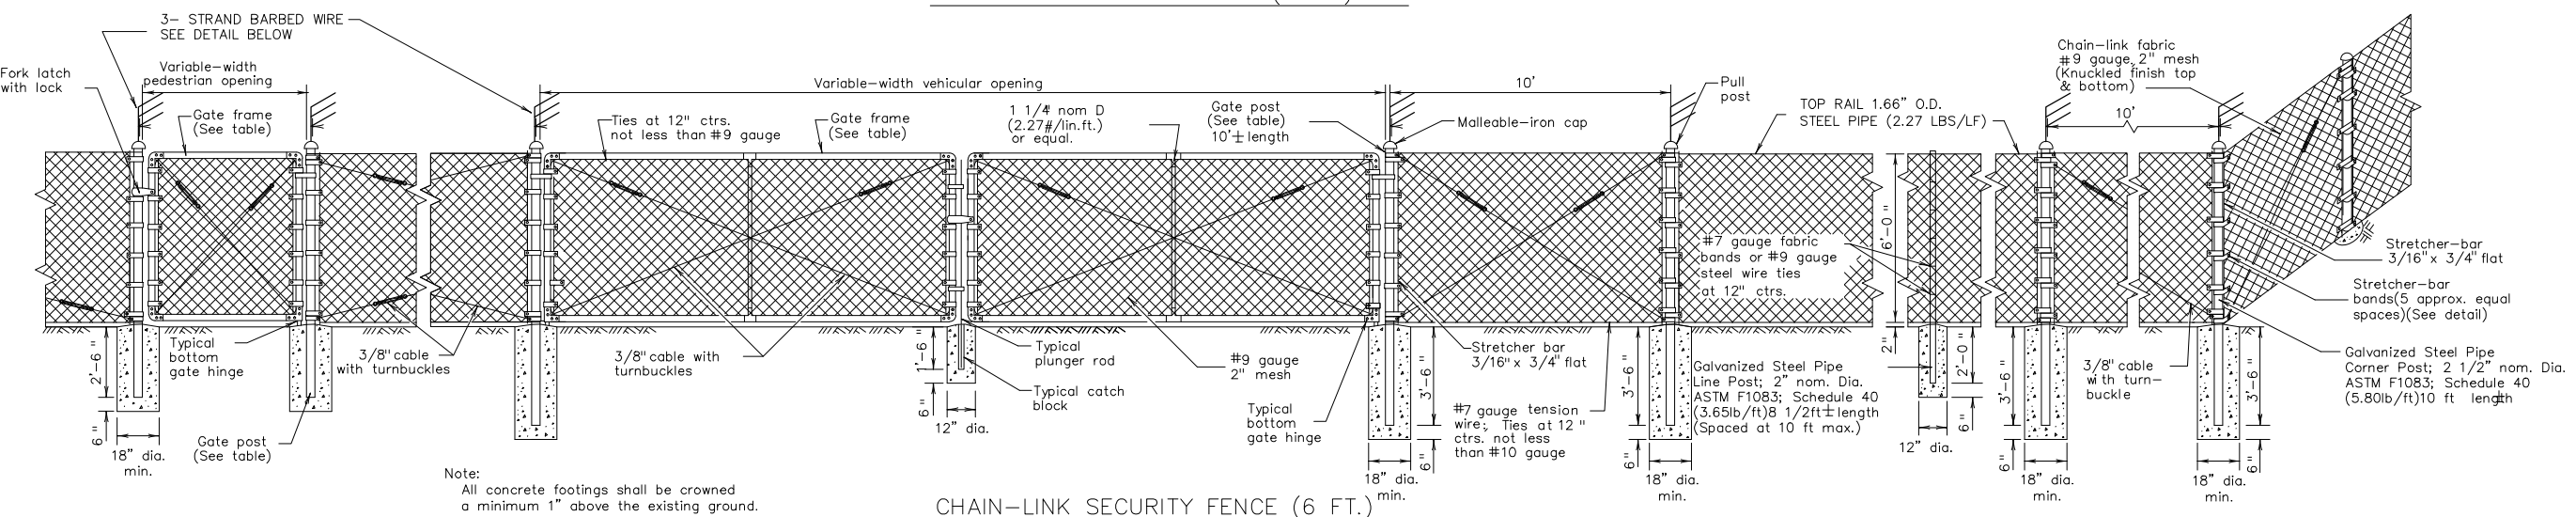




Note: All concrete footings shall be crowned a minimum 1\"/>

CHAIN-LINK SECURITY FENCE (6 FT.)

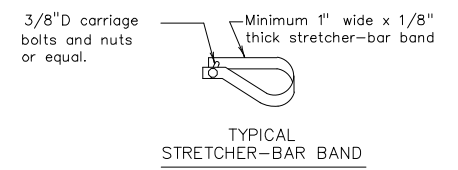

GATE (TYPES AND SIZES)	
Single Inclusive	Double Inclusive
Up to 6'	Up to 12'
Over 6' to 12'	Over 12' to 26'
Over 12' to 18'	Over 26' to 36'
Over 18'	Over 36'


GATE FRAME (WEIGHT)		GATE POST (WEIGHT)	
SIZE	WT./LIN. FT.	SIZE	WT./LIN. FT.
1 1/2" nom dia. or equal	2.72 Lbs.	2 1/2" nom dia. or equal	5.79 Lbs.
		3 1/2" nom dia. or equal	9.11 Lbs.
		6" nom dia.	18.97 Lbs.
		8" nom dia.	24.70 Lbs.

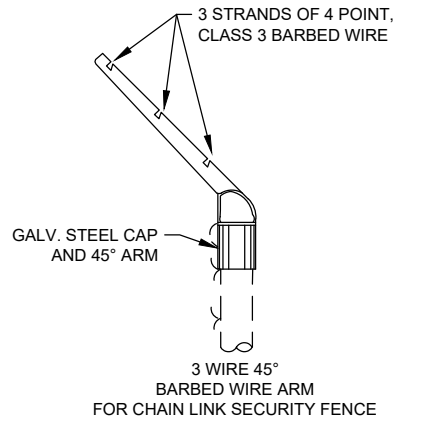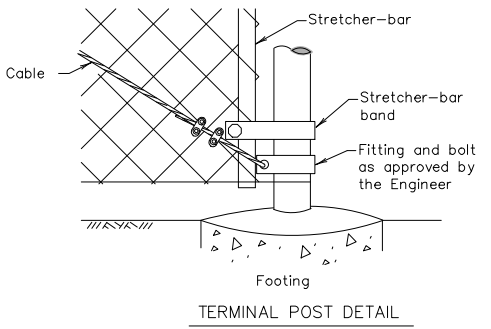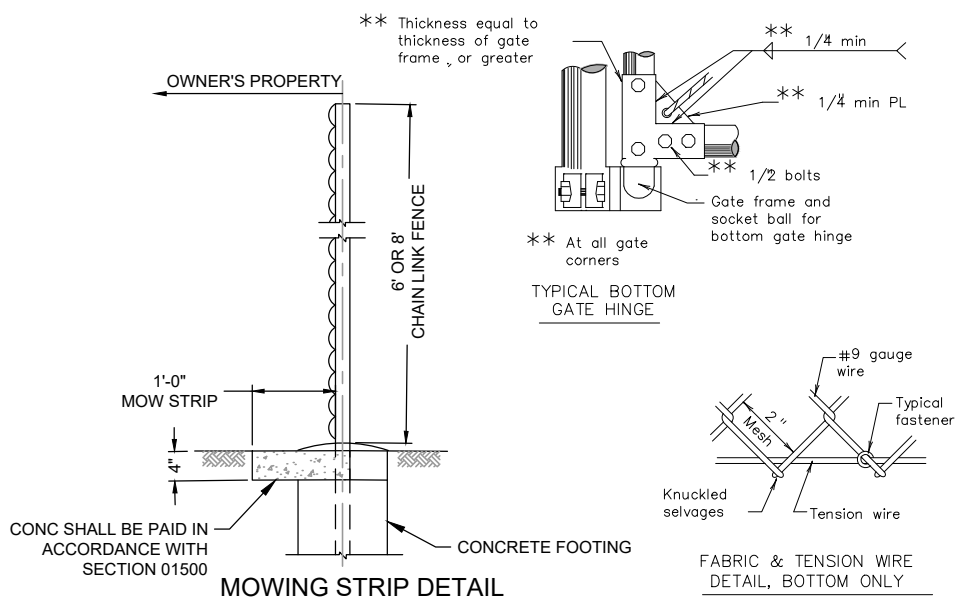

- GENERAL NOTES:**
- ITEMS HEREON SHALL CONFORM TO SECTION 1800, "CHAIN LINK FENCE".
 - TYPICAL INSTALLATION PLAN MAY VARY AS SHOWN ELSEWHERE ON THE PLANS OR AS DIRECTED BY THE ENGINEER. LOCATION OF GATES SHOWN ON PLANS.
 - GATE-FRAME MEMBERS SHALL BE BOLTED AT FRAME CORNERS TO JOINT FITTINGS WITH FOUR 1/2" BOLTS PER JOINT.
 - ALL CABLE CONNECTIONS ARE TO BE MADE WITH TWO 3/8" CABLE CLAMPS.
 - ALL PULL POSTS AND END POSTS AND THEIR FOUNDATIONS SHALL HAVE THE SAME RESPECTIVE DIMENSIONS AS THOSE SHOWN FOR CORNER POSTS.
 - ALL PULL POST SHALL BE FURNISHED WITH TWO STRETCHER BARS.
 - ONE END OF EACH TURNBUCKLE MAY BE ATTACHED DIRECTLY TO FITTINGS WITH A CLEVIS.
 - CONCRETE FOOTINGS ARE TO BE CROWNED AT THE TOP TO SHED WATER.

NOT TO SCALE

PROPERTY OF 	CHAIN LINK FENCE DETAIL	M&S ENGINEERING ELECTRICAL CIVIL MEP TXENG FIRM # F-1394 TBPCLS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446	APPROVED	REVISION
			JULY 2024	
SHEET			1	OF 1

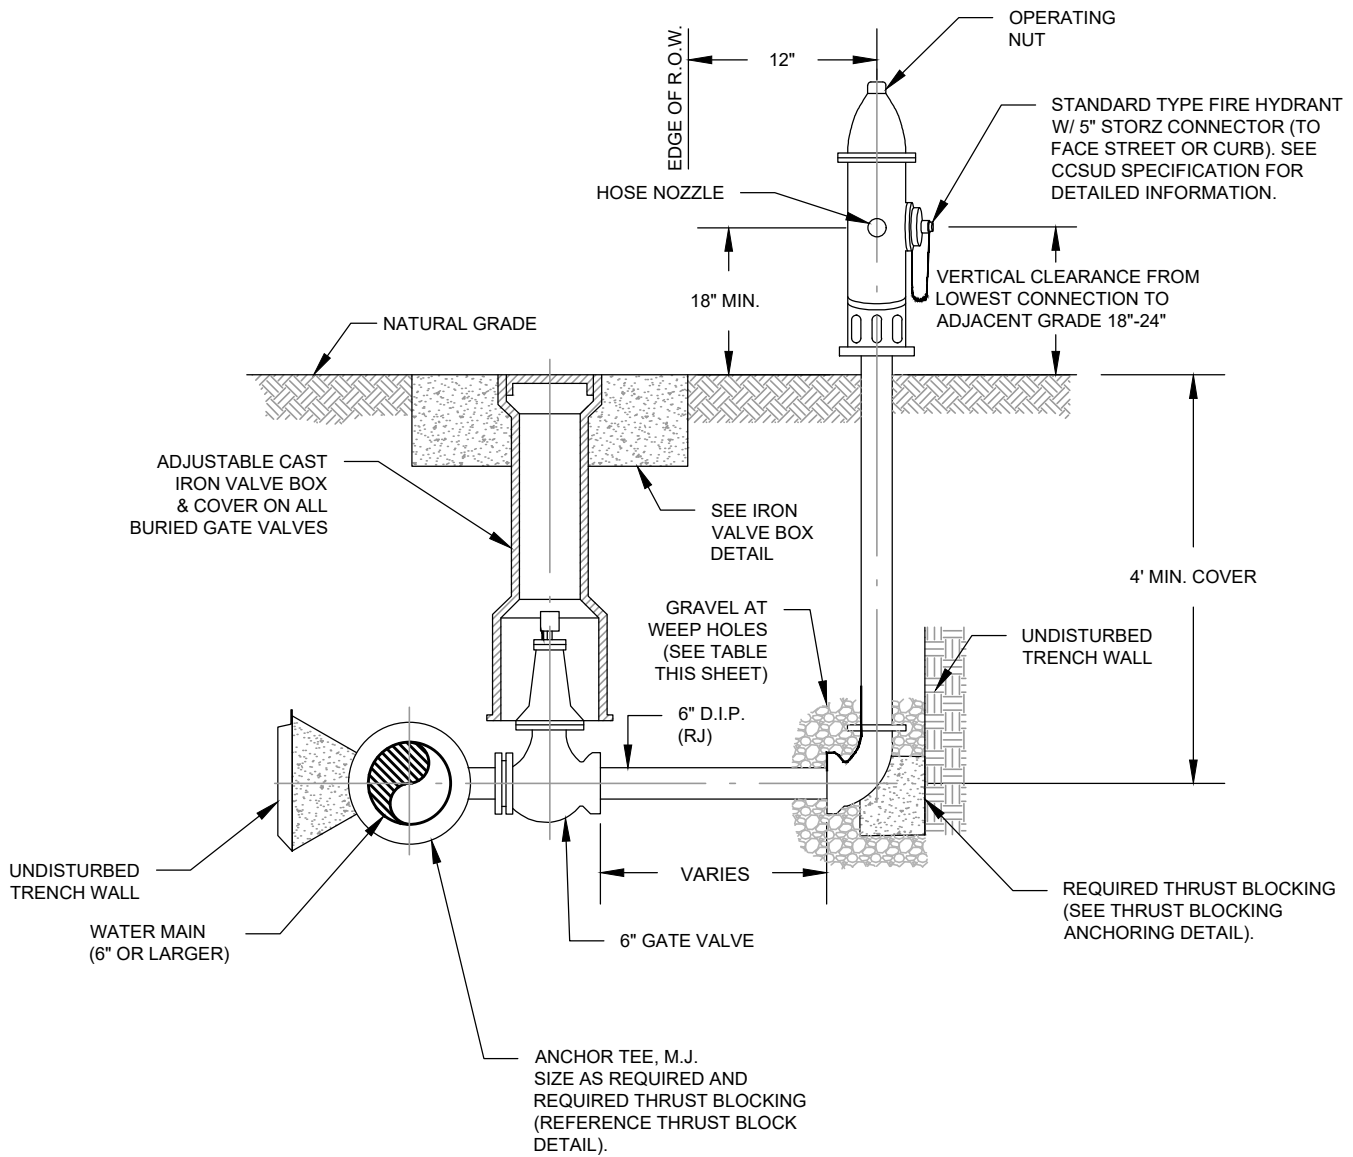


NOTE:

1. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
2. ALL PIPE JOINTS SHALL BE KEPT FREE FROM CONCRETE.
3. POLYWRAP SHALL BE SECURED WITH A MINIMUM OF THREE CIRCUMFERENTIAL TURNS OF POLY TAPE.
4. 12"x12"x4" THICK CONCRETE BLOCKS SHALL BE INSTALLED DIRECTLY UNDER ALL VALVES, FITTINGS, ETC.

GRAVEL AT WEEPHOLE	
LENGTH OF HYDRANT RISER	CU. FT. OF GRAVEL REQUIRED
3'	2.5
4'	3
5'	3.5
6'	4
>6'	TBD BY CCSUD

NOT TO SCALE

PROPERTY OF 	FIRE HYDRANT ASSEMBLY DETAIL (NEW BRAUNFELS)	M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			JUNE 2015	NOV 2021
SHEET 1 OF 1				

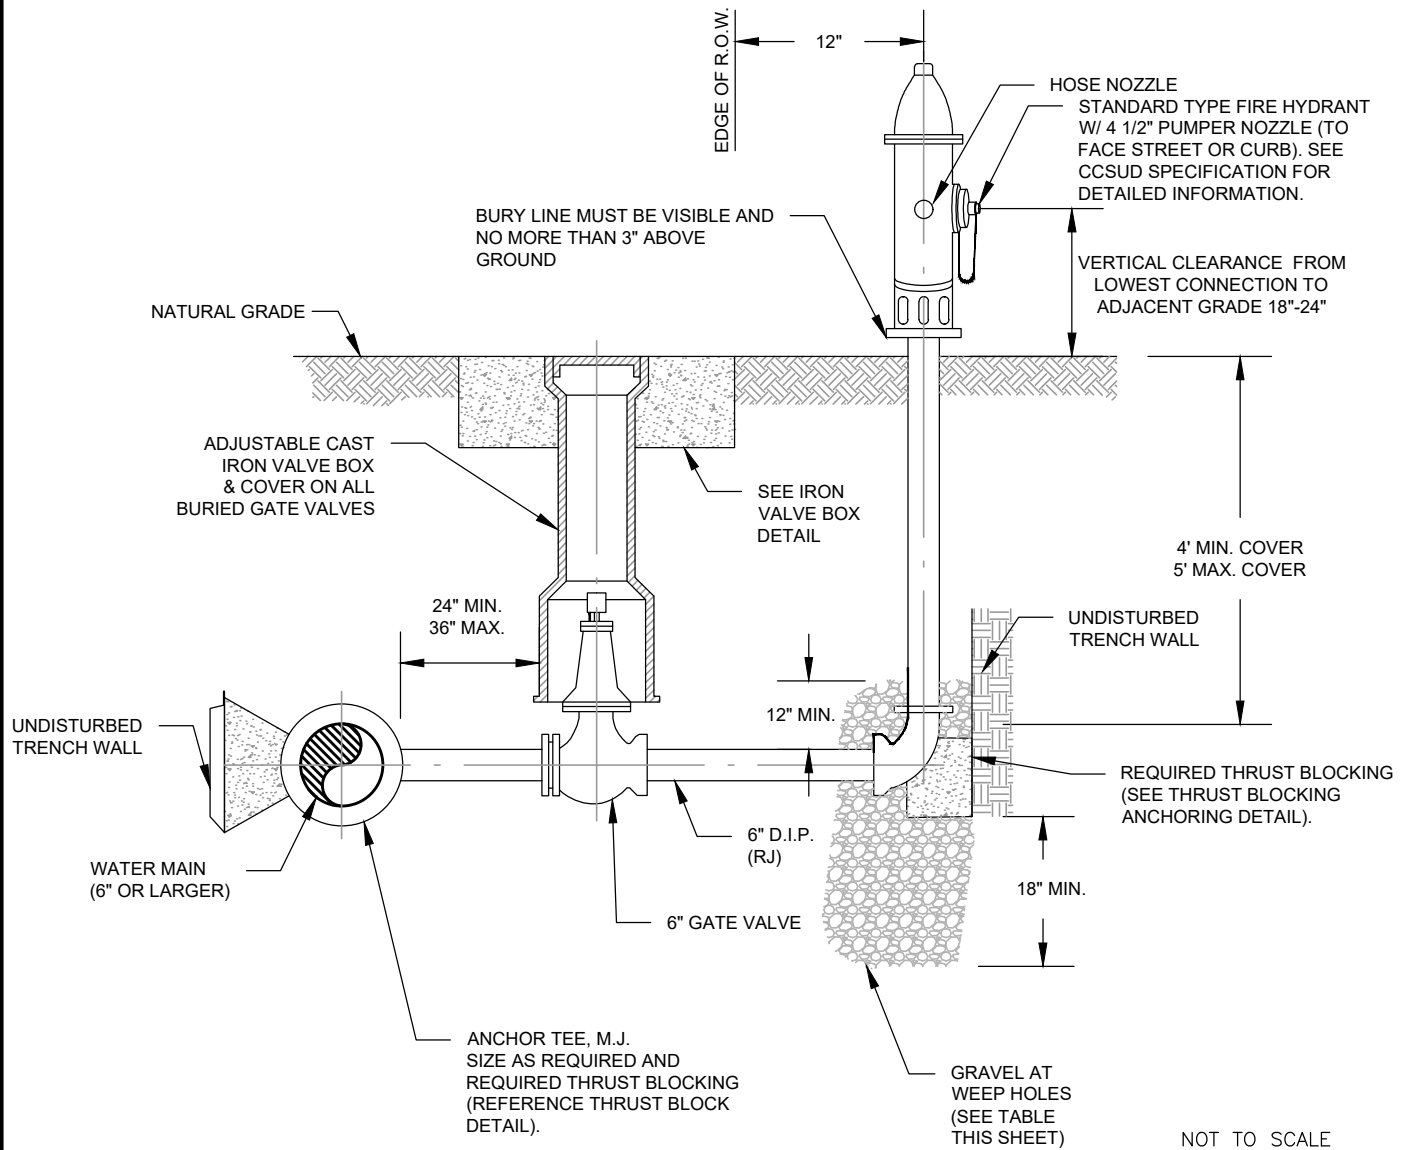

GRAVEL AT WEEPHOLE	
LENGTH OF HYDRANT RISER	CU. FT. OF GRAVEL REQUIRED
3'	2.5
4'	3
5'	3.5
6'	4
>6'	TBD BY CCSUD

NOTE:


1. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
2. ALL PIPE JOINTS SHALL BE KEPT FREE FROM CONCRETE.
3. ALL FITTINGS AND FITTING JOINTS MUST BE WRAPPED W/ THREE LAYERS OF 8-MIL POLYETHYLENE IN ACCORDANCE WITH AWWA C105-10, OR LATEST REVISION THERE OF.
4. POLYWRAP SHALL BE SECURED WITH A MINIMUM OF THREE CIRCUMFERENTIAL TURNS OF POLY TAPE.
5. THE FIRE HYDRANT SHALL BE PLACED A MINIMUM OF FIVE FEET FROM ALL OBSTRUCTIONS.
6. A BLUE REFLECTIVE PAVEMENT MARKER MUST BE PLACED WITH EVERY FIRE HYDRANT ADJACENT TO A ROADWAY 6" -10" OFF CENTER LINE OF ROAD ON FIRE HYDRANT SIDE.



PROPERTY OF
 FIRE HYDRANT ASSEMBLY DETAIL
 (SAN MARCOS)



APPROVED	REVISION
JUNE 2015	JULY 2021
SHEET	
1	OF 1

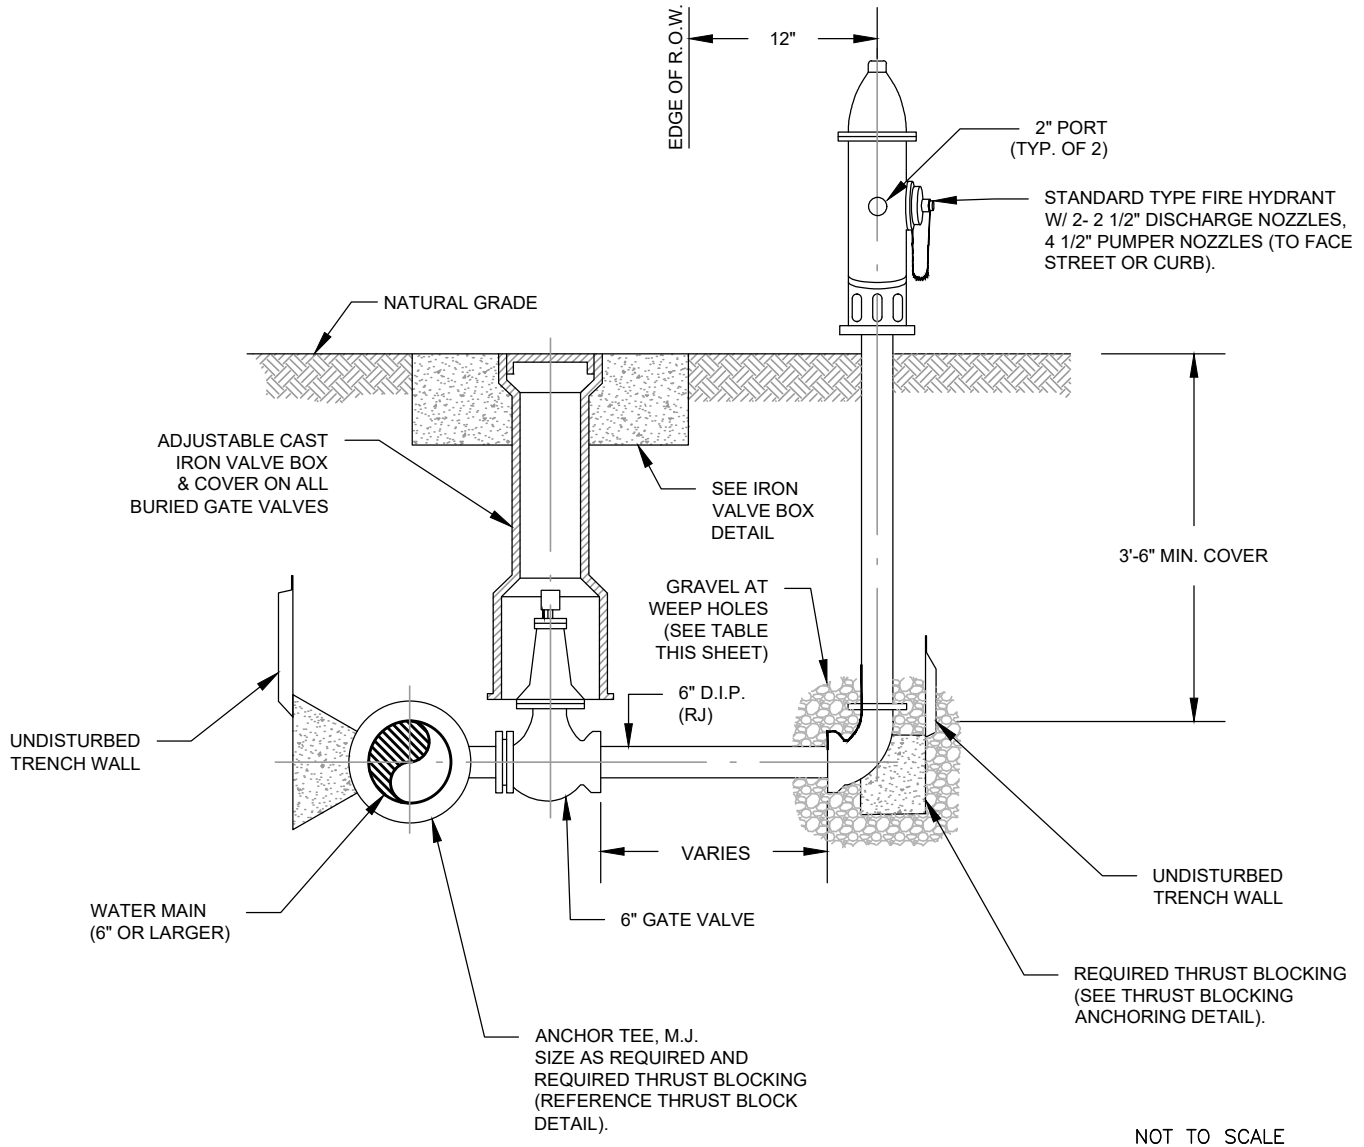


NOT TO SCALE

NOTE:

1. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
2. ALL PIPE JOINTS SHALL BE KEPT FREE FROM CONCRETE.
3. ALL FITTINGS AND FITTING JOINTS MUST BE WRAPPED W/ THREE LAYERS OF 8-MIL POLYETHYLENE IN ACCORDANCE WITH AWWA C105-10, OR LATEST REVISION THERE OF.
4. 12"x12"x4" THICK CONCRETE BLOCKS SHALL BE INSTALLED DIRECTLY UNDER ALL VALVES, FITTINGS, ETC.


GRAVEL AT WEEPHOLE	
LENGTH OF HYDRANT RISER	CU. FT. OF GRAVEL REQUIRED
3'	2.5
4'	3
5'	3.5
6'	4
>6'	TBD BY CCSUD

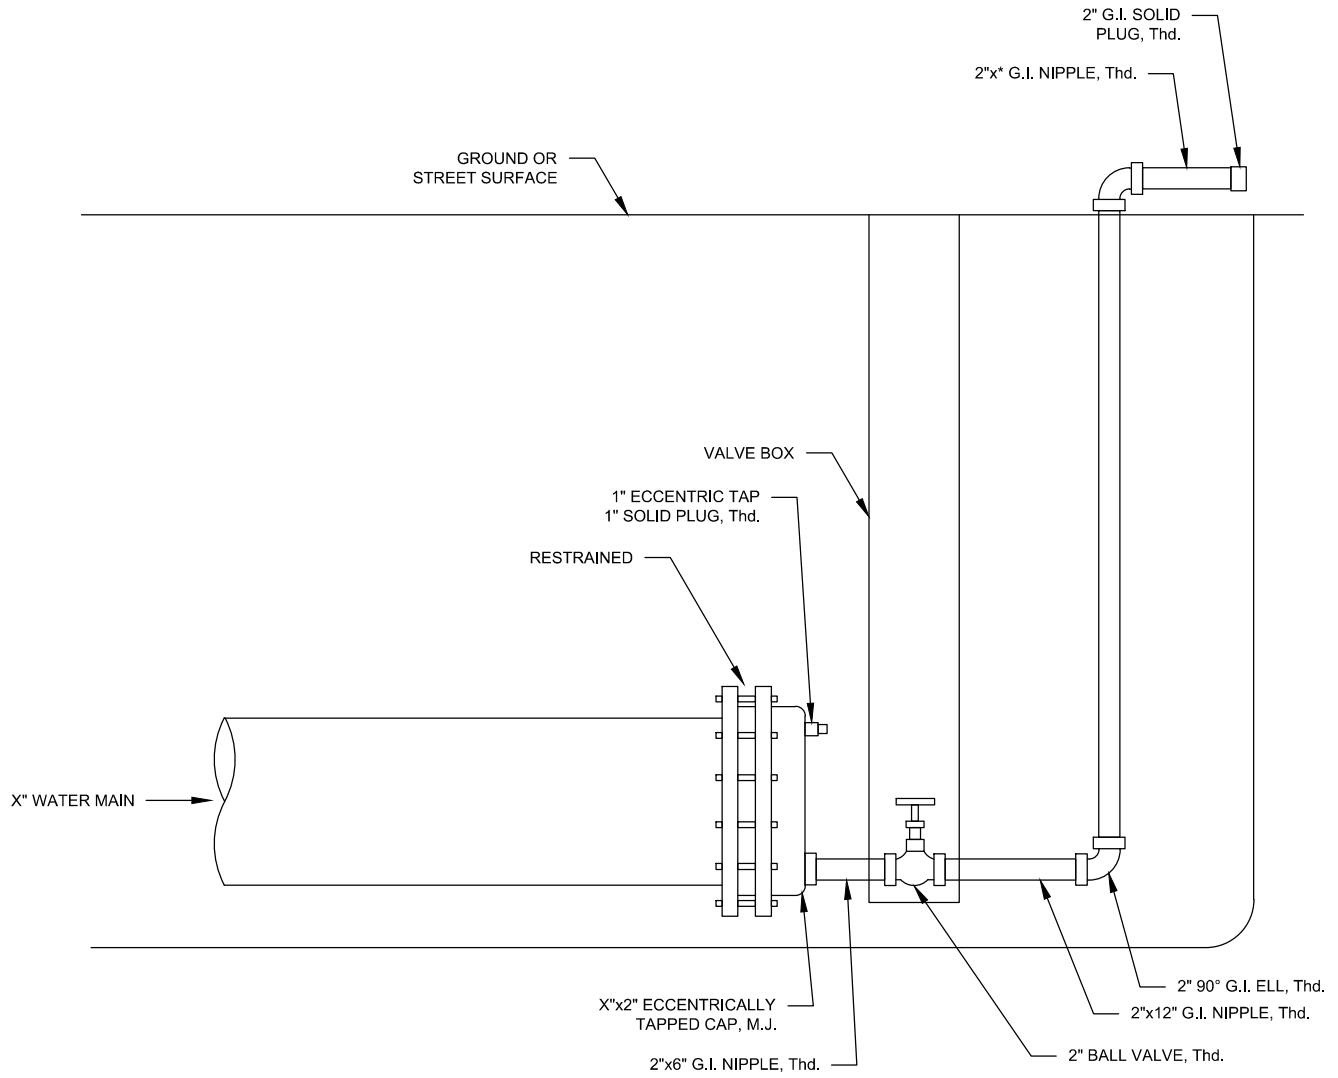


- NOTE:**
1. BURIED PIPING, FITTINGS, AND FITTINGS JOINTS SHALL BE WRAPPED IN POLYWRAP.
 2. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
 3. ALL PIPE JOINTS SHALL BE KEPT FREE FROM CONCRETE.
 4. POLYWRAP SHALL BE SECURED WITH A MINIMUM OF THREE CIRCUMFERENTIAL TURNS OF POLY TAPE.

NOT TO SCALE

 <p>PROPERTY OF</p>	<p>FLUSH VALVE DETAIL</p>	 <p>M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small></p>	APPROVED	REVISION
			OCTOBER 2020	OCTOBER 2023
			<p>SHEET</p> <p>1 OF 1</p>	

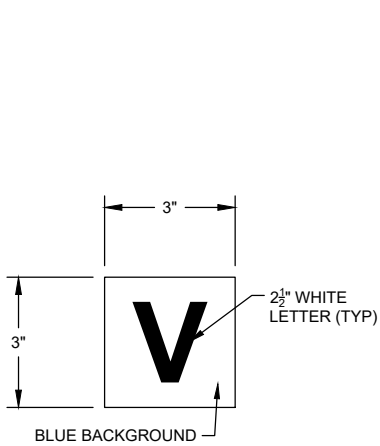


**DECAL
DETAIL**

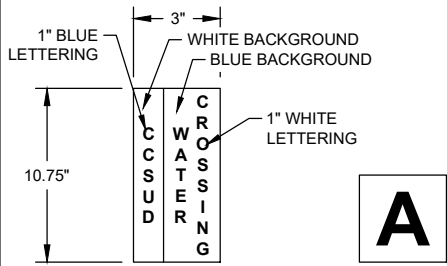

**WATER
CROSSING**



DECALS

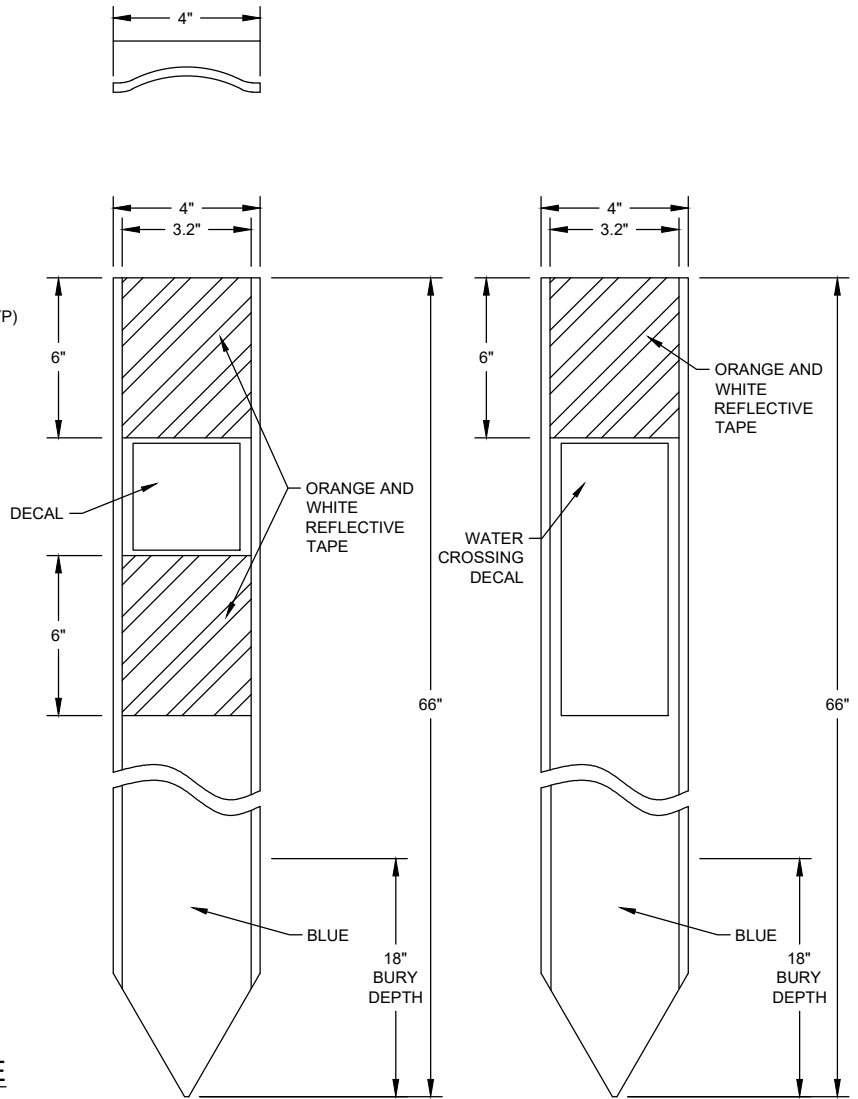


**MARKER
DETAIL**

NOTES:

1. MARKERS SHALL BE 66" COMPOSITE POSTS SIMILAR TO RHINO FIBERCURVE COMPOSITE MARKER POST.
2. MARKERS SHALL BE PLACED AT ALL GATE VALVES, FLUSHING VALVES, & AIR RELEASE VALVES PER ITEM DETAIL.
3. MARKERS SHALL BE PLACED AT WATER METERS AS SPECIFIED ON PLANS
4. PIPELINE MARKERS SHALL BE PLACED ON R.O.W./FENCE LINE AT ALL ROAD CROSSINGS.



NOT TO SCALE

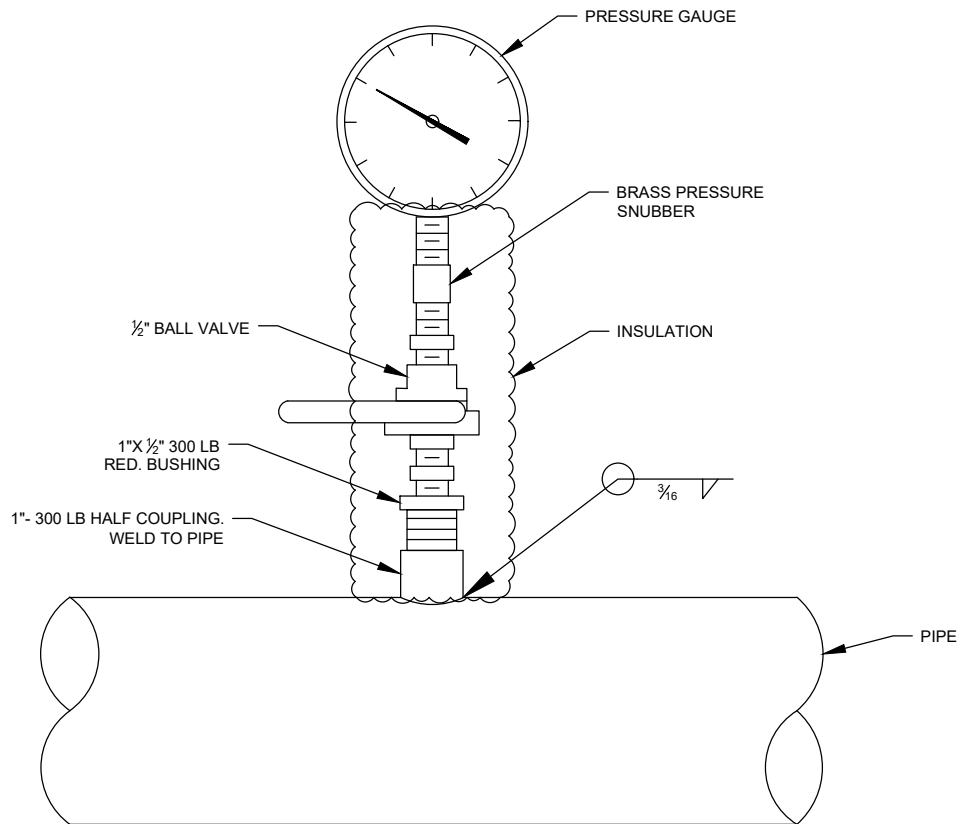

PRESSURE GAUGE DETAIL
 N.T.S.

NOT TO SCALE

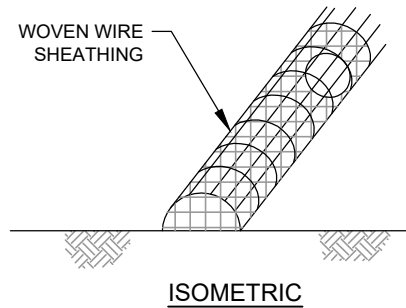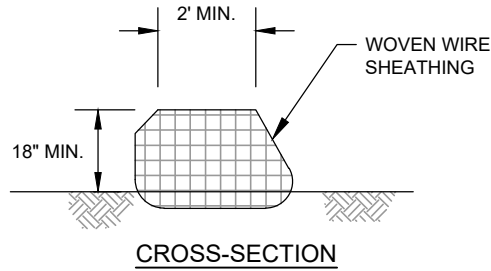

PROPERTY OF 	PRESSURE GAUGE DETAIL	 M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			APRIL 2023	
			SHEET 1 OF 1	




GENERAL NOTES

1. USE ONLY OPEN GRADED ROCK 4-8 INCH DIAMETER FOR STREAM FLOW CONDITIONS. USE OPEN GRADED ROCK 3-5 INCH DIAMETER FOR OTHER CONDITIONS.
2. THE ROCK BERM SHALL BE SECURED WITH A WOVEN WIRE SHEATHING HAVING MAXIMUM 1 INCH OPENING AND MINIMUM WIRE DIAMETER OF 20 GAUGE.
3. THE ROCK BERM SHALL BE INSPECTED WEEKLY OR AFTER EACH RAIN, AND THE STONE AND/OR FABRIC CORE-WOVEN WIRE SHEATHING SHALL BE REPLACED WHEN THE STRUCTURE CEASES TO FUNCTION AS INTENDED, DUE TO SILT ACCUMULATION AMONG THE ROCKS, WASHOUT, CONSTRUCTION TRAFFIC DAMAGE, ETC.
4. WHEN SILT REACHES A DEPTH EQUAL TO ONE-THIRD THE HEIGHT OF THE BERM OR ONE FOOT, WHICHEVER IS LESS, THE SILT SHALL BE REMOVED AND DISPOSED OF IN APPROVED SITE AND IN A MANNER AS TO NOT CREATE A SILTATION PROBLEM.
5. DAILY INSPECTION SHALL BE MADE ON SEVERE SERVICE ROCK BERMS. SILT SHALL BE REMOVED WHEN ACCUMULATION REACHES 6 INCHES.
6. WHEN THE SITE IS COMPLETELY STABILIZED, THE BERM AND ACCUMULATED SILT SHALL BE REMOVED AND DISPOSED OF IN AN APPROVED MANNER.

NOT TO SCALE

 <p>PROPERTY OF</p>	<p>ROCK BERM DETAILS</p>	 <p>M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small></p>	APPROVED	REVISION
			JUNE 2015	JUNE 2015
			<p>SHEET</p> <p>1 OF 1</p>	

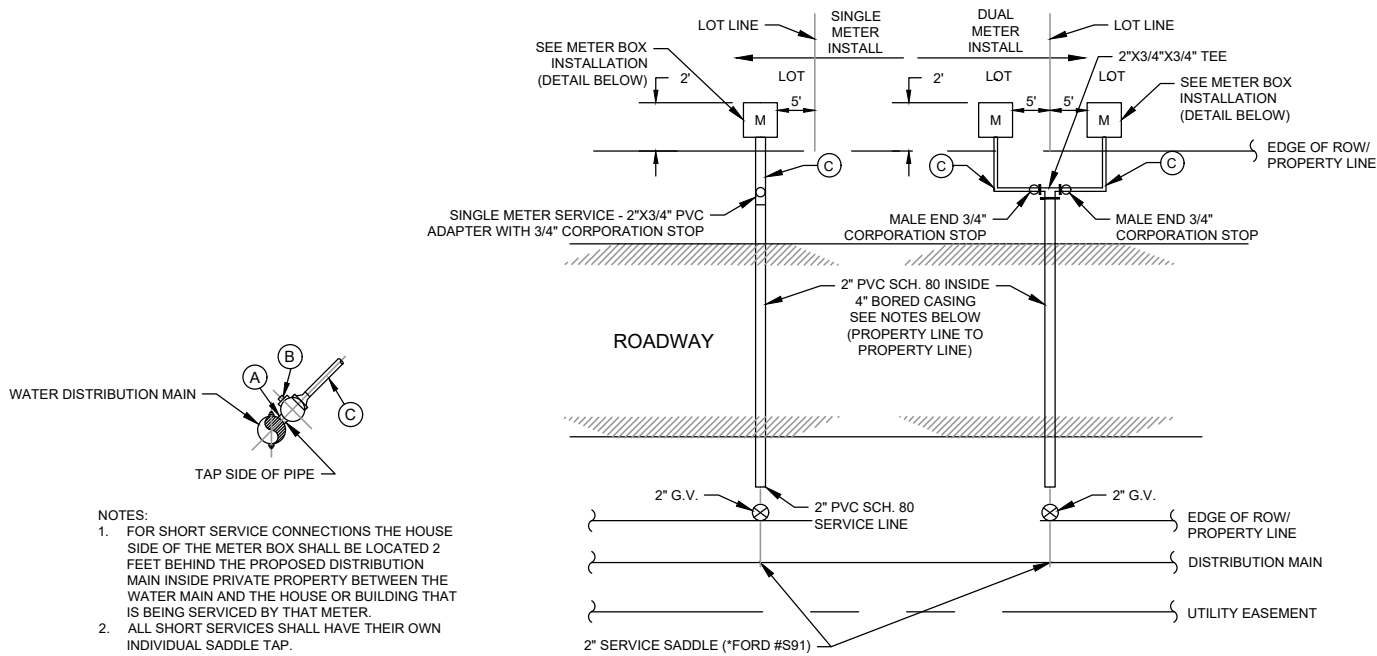

NOTES:


- FOR SHORT SERVICE CONNECTIONS THE HOUSE SIDE OF THE METER BOX SHALL BE LOCATED 2 FEET BEHIND THE PROPOSED DISTRIBUTION MAIN INSIDE PRIVATE PROPERTY BETWEEN THE WATER MAIN AND THE HOUSE OR BUILDING THAT IS BEING SERVICED BY THAT METER.
- ALL SHORT SERVICES SHALL HAVE THEIR OWN INDIVIDUAL SADDLE TAP.
- ONE (1) 3/4" CORPORATION STOP SHALL BE INSTALLED FOR SINGLE METER INSTALLATION. REFER TO LONG SERVICE DETAIL FOR LAYOUT AND TYPE.
- METERS SHALL BE HORIZONTALLY PLACED 5 FEET FROM THE LOT LINE.

NOTES:

- HDPE CASING SHALL BE USED WHEN SERVICE LINES ARE BORED.
- SCHEDULE 80 PVC MAY BE USED FOR OPEN CUT INSTALLATIONS.
- FOR LONG SERVICE CONNECTION, THE HOUSE SIDE OF THE METER BOX SHALL BE 2 FEET INSIDE THE EASEMENT IN PRIVATE PROPERTY.
- METERS SHALL BE HORIZONTALLY PLACED 5 FEET FROM THE LOT LINE.

SHORT SERVICE DETAIL


LONG SERVICE DETAIL

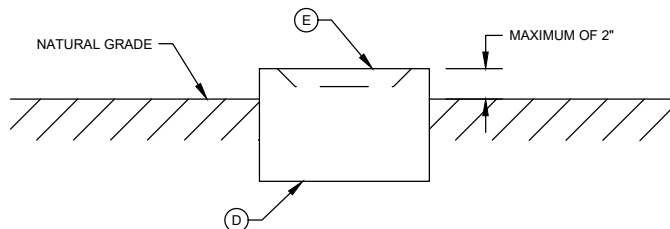

NOTES:

- METER BOX SHALL BE SET INTO GROUND TO SIT SLIGHTLY ABOVE NATURAL GRADE (NO MORE THAN 2").
- USE NATIVE TOP SOIL TO BACKFILL TO EDGE OF METER BOX LID. BACKFILL TO NATURAL GRADE.

METER BOX PROFILE

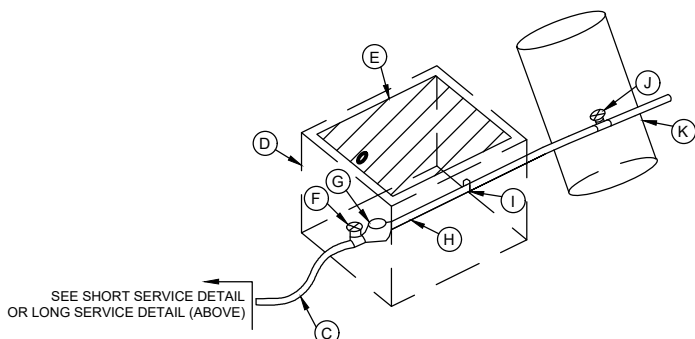

MATERIAL LIST

- A. 3/4" SERVICE SADDLE FORD #S91 OR SMITH-BLAIR MODEL 317
- B. 3/4" CORP. STOP (I.P. x COMP) FORD #FB1100-3-G-NL
- C. 3/4" POLYETHYLENE AWWA, C901-200 PSI
- D. PLASTIC METER BOX, MODEL NO. DFW1300.12.1C OR DFW1600X.12.1C
- E. METER BOX LID, MODEL NO. DFW1200.1C.LID OR DFW1500.1C.LID
- F. 3/4" BALL VALVE (METER CONV. x COMP.) FORD #BA43-332W-G-NL
- G. 5/8"x3/4" WATER METER (BY CCSUD)
- H. 3/4" DUAL CHECK VALVE (METER x I.P.) FORD #HHC31-323 (BY OWNER)
- I. SERVICE LINE (BY OWNER)
- J. CUSTOMER SHUT OFF VALVE (BY OWNER) FORD #644-333-NL
- K. 7-INCH ROUND VALVE BOX WITH REMOVABLE LID (BY OWNER)

*MATERIALS SHALL BE PER THE APPROVED EQUIPMENT LIST (AEL) OR APPROVED EQUIVALENT.

METER BOX INSTALLATION DETAIL

NOT TO SCALE



SERVICE CONNECTION
 DETAILS



APPROVED	REVISION
JUNE 2015	APRIL 2024


SHEET
 1 OF 1

GENERAL NOTES

1. THE INSTALLER SHALL FOLLOW THE REQUIREMENTS FOR TEMPORARY AND PERMANENT EROSION AND SEDIMENTATION CONTROLS, INSPECTION AND MAINTENANCE PROCEDURES LISTED IN THE NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM STORMWATER POLLUTION PREVENTION PLAN.
2. THE INSTALLER AND ALL SUBCONTRACTORS SHALL COMPLETE THE POLLUTION PLAN CERTIFICATION.
3. A COPY OF THE POLLUTION PREVENTION PLAN SHALL BE KEPT AT THE CONSTRUCTION SITE FROM THE TIME CONSTRUCTION BEGINS UNTIL THE SITE IS FINALLY STABILIZED.
4. INSPECTION AND MAINTENANCE FORMS SHALL BE COMPLETED AS REQUIRED IN THE POLLUTION PLAN.
5. THE STORM WATER POLLUTION PREVENTION PLAN AND ALL OTHER RECORDS REQUIRED BY THE PERMIT SHALL BE RETAINED FOR THREE YEARS AFTER COMPLETION OF FINAL SITE STABILIZATION.
6. THE POLLUTION PREVENTION PLAN AND ASSOCIATED RECORDS MUST BE MADE AVAILABLE UPON REQUEST TO THE EPA'S DIRECTOR, OR ANY STATE OR LOCAL AGENCY WHO IS APPROVING EROSION AND SEDIMENTATION CONTROL PLANS AND TO THE OWNER AND ENGINEER.

GENERAL NOTES

1. STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST MUST BE IMBEDDED A MINIMUM OF ONE FOOT.
2. THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPACE OR MECHANICAL TRENCHER SO THAT THE DOWN SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G. PAVEMENT), WEIGHT FABRIC FLAP WITH WASHED GRAVEL ON UPHILL SIDE TO PREVENT FLOW UNDER FENCE.
3. THE TRENCH MUST BE A MINIMUM OF 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.
4. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST.
5. INSPECTION SHALL BE MADE WEEKLY OR AFTER EACH RAINFALL EVENT AND REPAIR OR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
6. SILT FENCE SHALL BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
7. ACCUMULATED SILT SHALL BE REMOVED WHEN IT REACHES A DEPTH OF 6 INCHES. THE SILT SHALL BE DISPOSED OF IN AN APPROVED SITE AND IN SUCH A MANNER AS NOT TO CONTRIBUTE TO ADDITIONAL SILTATION.

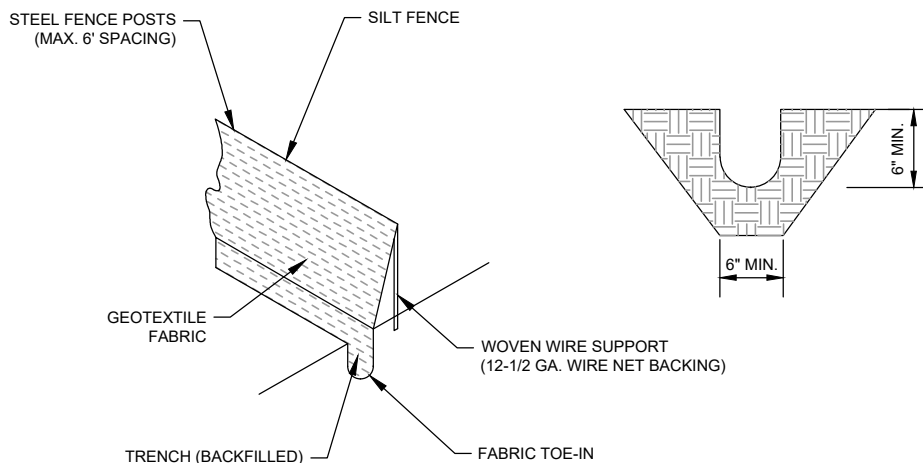

SILT FENCE DETAIL
N.T.S.

NOT TO SCALE

PROPERTY OF



SILT FENCE DETAILS



M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
 TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446

APPROVED


REVISION

JUNE 2015

JUNE 2015

SHEET

1 OF 1

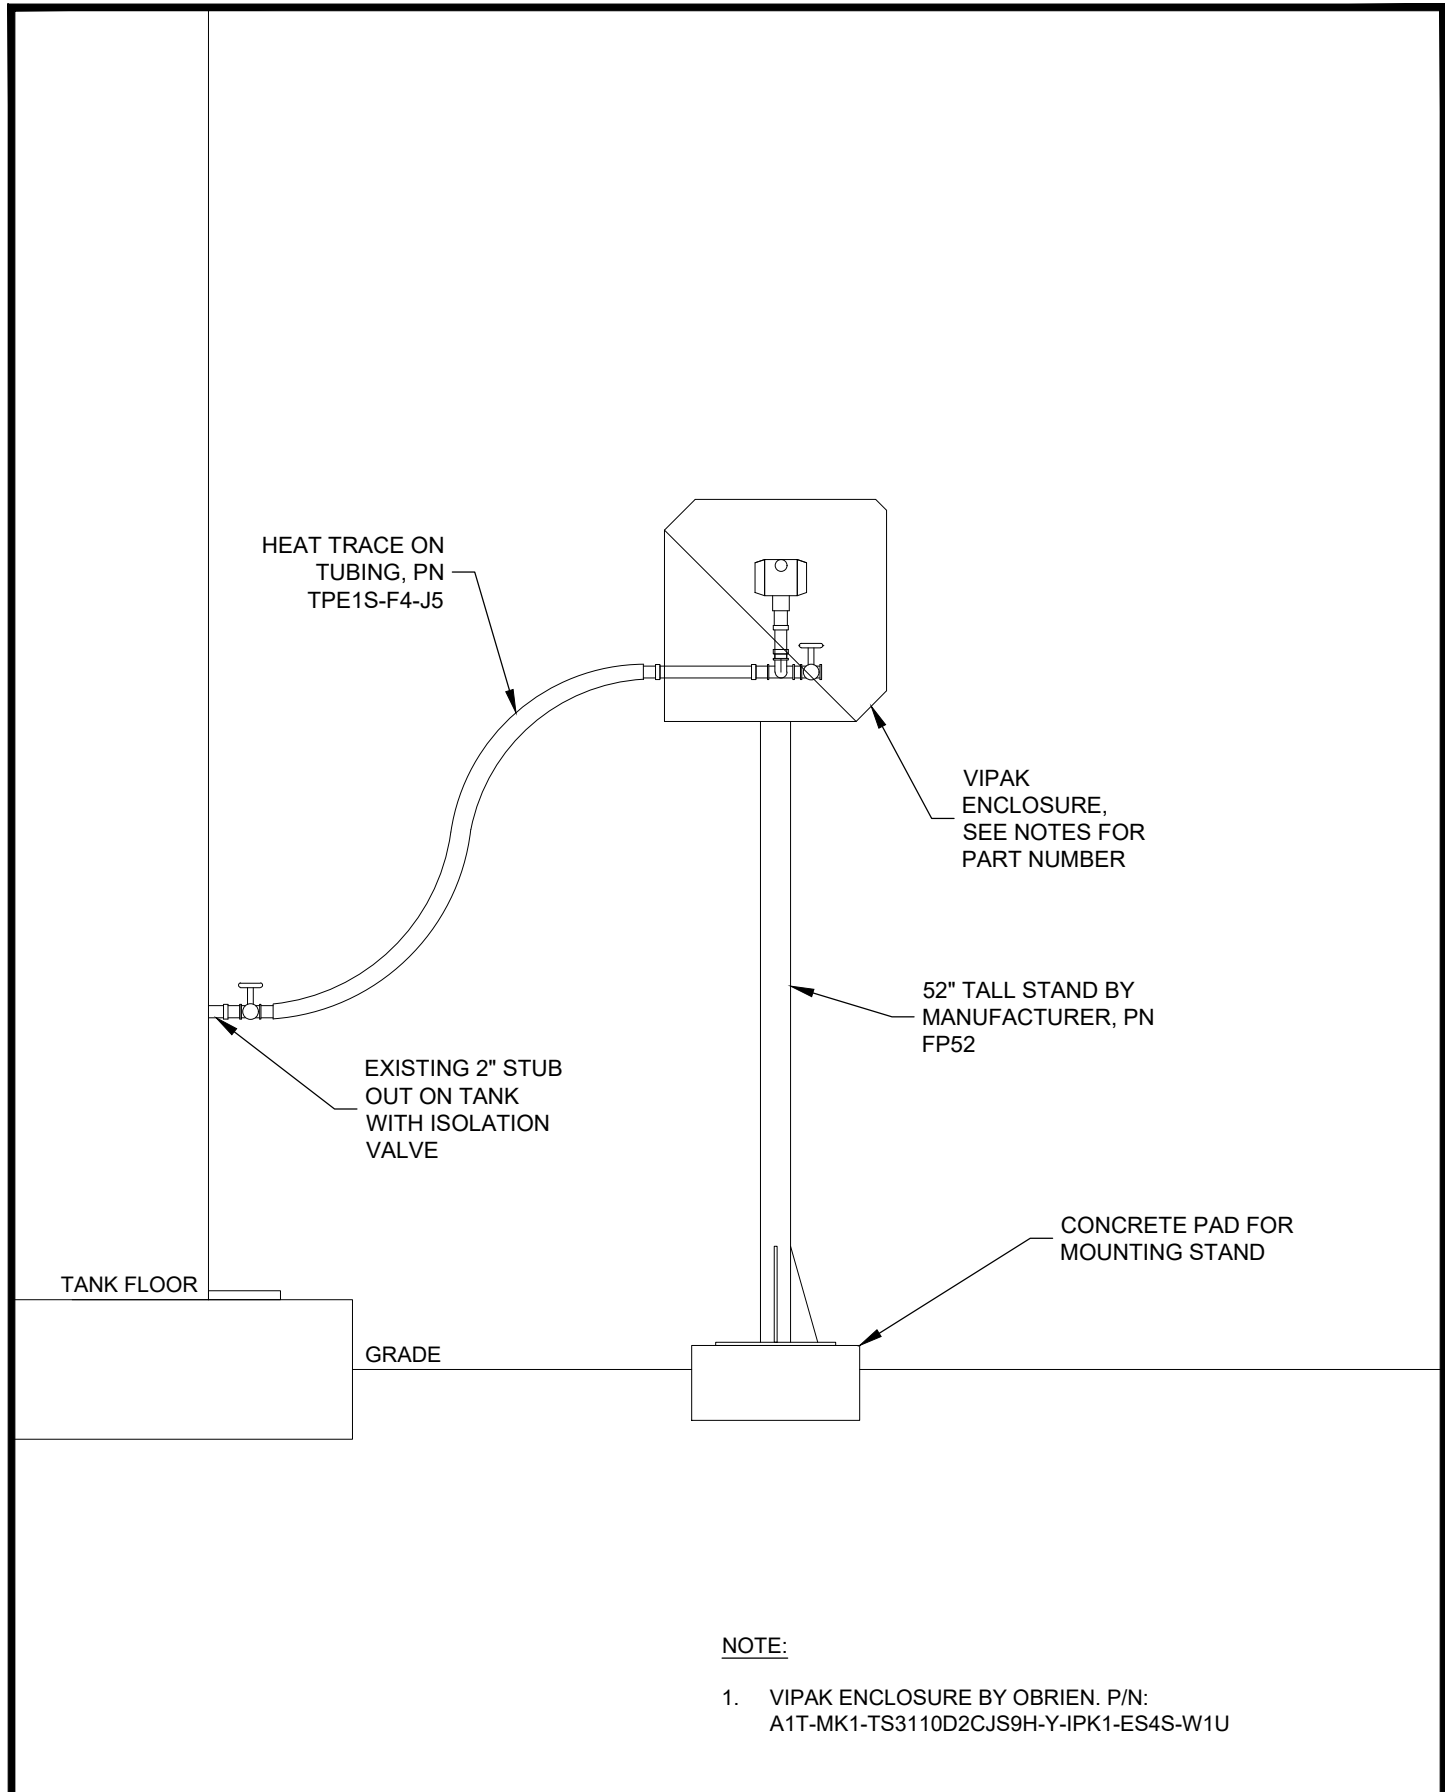

NOTE:

- VIPAK ENCLOSURE BY OBIEN. P/N: A1T-MK1-TS3110D2CJS9H-Y-IPK1-ES4S-W1U


PROPERTY OF 	TANK TRANSMITTER ENCLOSURE DETAIL	 M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			SEPT 2021	
			SHEET 1 OF 1	

PIPE SIZE	DIMENSION "B" (SQUARE)				
	PLUGS & TEES	90° BENDS	45° BENDS	22 1/2° BENDS	VALVES
4" & 6"	1'-3"	1'-6"	1'-0"	9"	1'-3"
8"	1'-9"	2'-0"	1'-6"	1'-0"	1'-6"
10"	2'-10"	2'-0"	1'-9"	1'-3"	2'-0"
12"	2'-6"	3'-0"	2'-3"	1'-6"	2'-3"
16"	3'-3"	4'-0"	2'-9"	2'-0"	2'-9"
20"	3'-9"	4'-6"	3'-3"	2'-3"	3'-3"


DIMENSION "A" SHALL BE A MINIMUM OF 1'-0" BUT IS TO BE INCREASED WHERE NECESSARY TO PROVIDE BEARING AGAINST UNDISTURBED TRENCH WALL.

NOTES:


1. THE EARTHBEARING SURFACE SHALL BE THE UNDISTURBED TRENCH WALL.
2. CONCRETE SHALL BE PLACED SO THAT FITTING, VALVES AND PIPE JOINTS ARE ACCESSIBLE FOR REPAIR OR REPLACEMENT.
3. ALL THRUST BLOCKS SHALL CONTAIN A MINIMUM OF 1 1/2 CUBIC YARDS OF CONCRETE.
4. CONCRETE SHALL BE 3000 P.S.I. AT 28 DAYS MINIMUM.
5. ALL FITTINGS AND FITTING JOINTS MUST BE WRAPPED W/ POLYWRAP. POLYWRAP SHALL BE SECURED WITH A MINIMUM OF THREE CIRCUMFERENTIAL TURNS OF POLY TAPE.
6. 12"x12"x4" THICK CONCRETE BLOCKS SHALL BE INSTALLED DIRECTLY UNDER ALL FITTINGS.

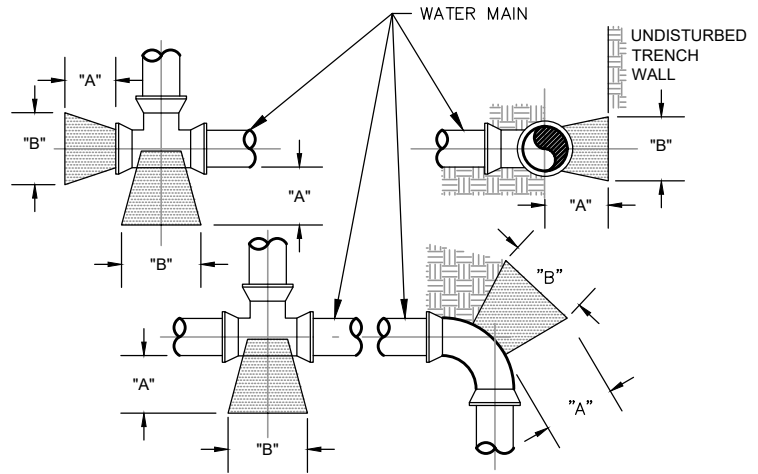

THRUST BLOCK DIMENSIONING

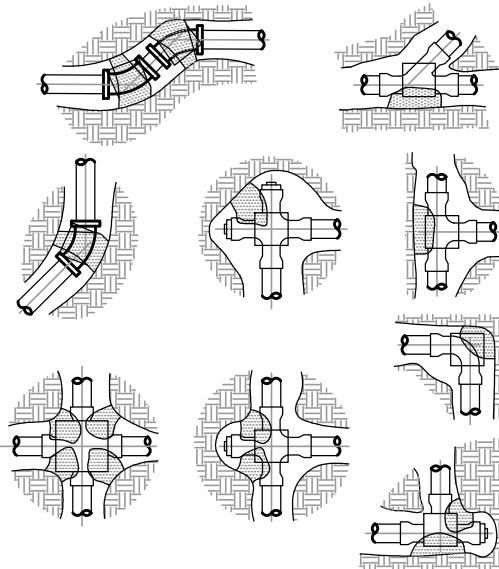


THRUST BLOCK FOR FITTINGS DETAIL

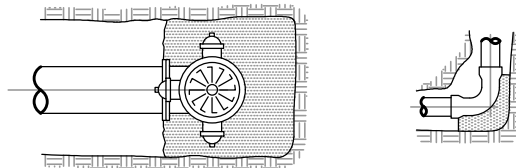


PLAN
POUR BASE AFTER
HYDRANT HAS BEEN
PLACED

ELEVATION

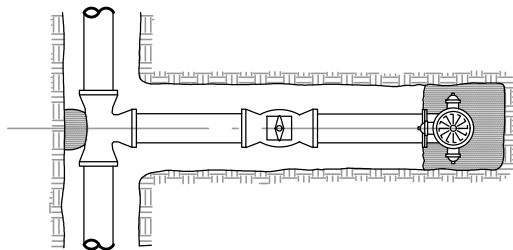


THRUST BLOCK FOR HYDRANTS DETAIL

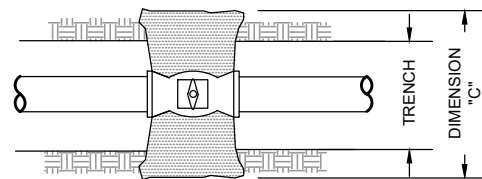

VALVE SUPPORT PLAN

VALVE THRUST BLOCK DIMENSIONS AND NOTES:

1. DIMENSION "A" = WIDTH OF THE VALVE BODY.
2. DIMENSION "B" = PIPE DIAMETER PLUS D3 DEPTH FROM TRENCH BACKFILL DETAIL.
3. DIMENSION "C" = TRENCH WIDTH PLUS TWO TIMES THE PIPE DIAMETER.
4. CONCRETE THRUST BLOCKS SHALL NOT COVER VALVE ENDS, BONNET, STEM, NUTS OR BOLTS. THEY SHALL COVER THE VALVE BODY ONLY PER THE GIVEN DIMENSIONS.

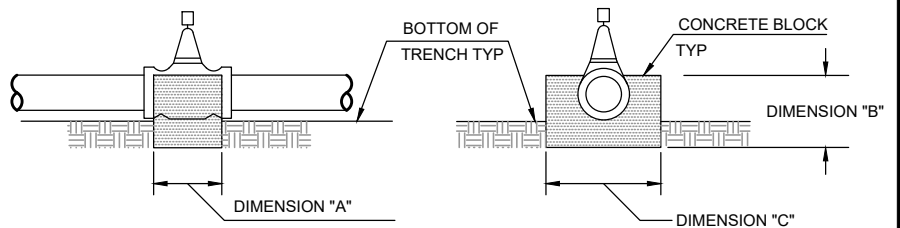

VALVE SUPPORT ELEVATION

THRUST BLOCK FOR VALVES DETAIL

NOT TO SCALE



THRUST BLOCKING DETAILS




M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
 TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446

APPROVED REVISION

JUNE 2015 JULY 2024

SHEET

1 OF 1

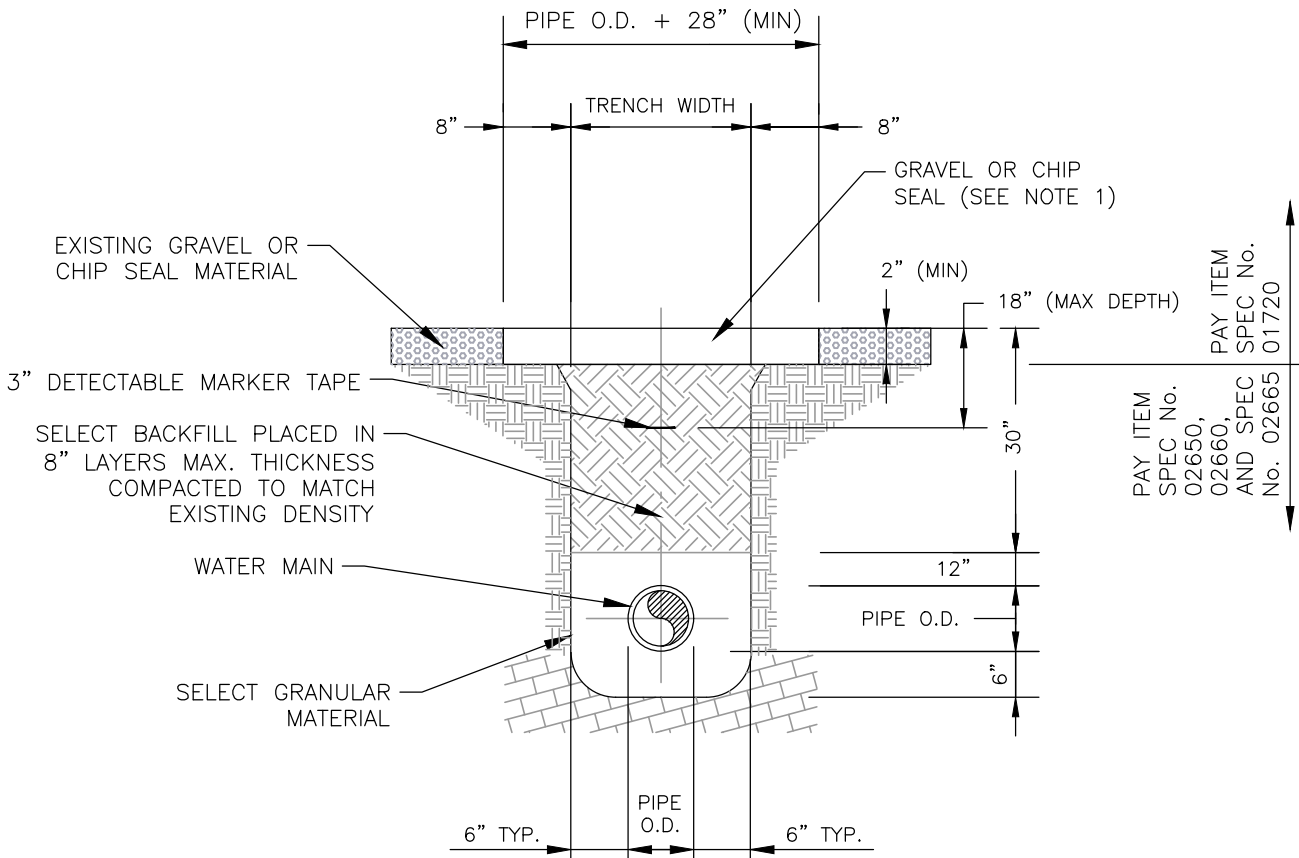

PAY ITEM SPEC No. 02650, 02660, AND SPEC No. 01720
 PAY ITEM SPEC No. 02665 AND SPEC No. 02665

NOTES

1. GRAVEL OR CHIP SEAL (MATCH EXISTING PAVEMENT TYPE) SHALL BE A MINIMUM OF 2" THICK.
2. ROAD BASE AND SURFACE MATERIALS IN THE TRENCH CUT SHALL BE REPLACED IN KIND, OF EQUAL THICKNESS

TRENCHING NOTES

1. ADEQUATE BARRICADES & WARNING SIGNS SHALL BE ERECTED BEFORE ANY WORK IS STARTED IN PUBLIC RIGHT-OF-WAY.
2. THE DRIVEWAY SHALL BE CUT ONLY WHERE REQUIRED BY THE ENGINEER.
3. DRIVEWAY SHALL REMAIN ACCESSIBLE AT ALL TIMES.
4. REFER TO SPECIFICATIONS FOR ANY SPECIAL REQUIREMENTS OR CONDITIONS
5. BACKFILL SHALL BE COMPLETED IMMEDIATELY AFTER PIPELINE LAYING WITHIN PRIVATE DRIVEWAYS.

TRENCH SAFETY NOTES

1. TRENCH SAFETY SYSTEM, SHORING OR SIDE SLOPE TO BE IN ACCORDANCE WITH OSHA STANDARDS.
2. TRENCH SAFETY SYSTEM PLAN TO BE PROVIDED BY CONTRACTOR PRIOR TO CONSTRUCTION.
3. ALL EXCAVATION GREATER THAN 5' DEEP SHALL MEET TRENCH SAFETY NOTE.

NOT TO SCALE



TYPICAL GRAVEL/CHIP SEAL
 DRIVEWAY REPAIR DETAIL




M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446


APPROVED	REVISION
JULY 2019	AUGUST 2022

SHEET

1 OF 1

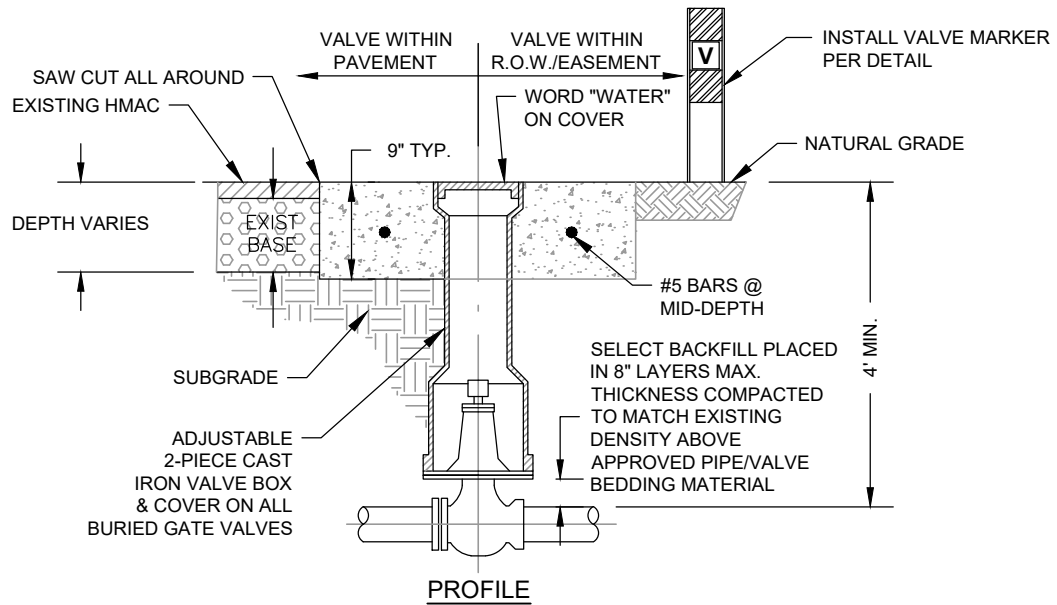

PROFILE

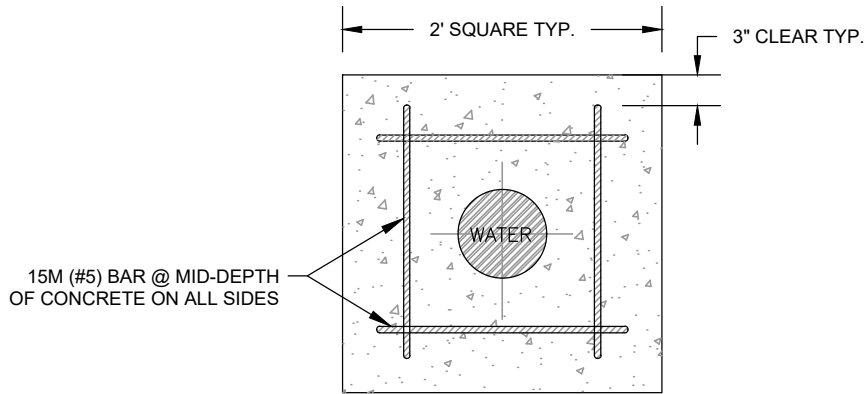

PLAN

NOTES:

1. VALVE BOXES SHALL BE FITTED WITH PLASTIC VALVE ID TAGS (BLUE EMEDCO 3-1/2" X 2-3/4") INDICATING OWNER (CCSUD) VALVE SIZE, YEAR OF INSTALLATION AND # OF TURNS TO OPEN.
2. SUBGRADE SHALL BE COMPACTED AS PER SPECIFICATIONS
3. VALVE CASTINGS SHALL BE ADJUSTED TO GRADE AFTER FINAL LIFT OF OVERLAY IS IN PLACE.
4. CLEAN VALVE BOX OF ALL DEBRIS DOWN TO THE BASE OF THE VALVE.
5. REMOVE EXISTING RISER PIPE DOWN 18" AND REPLACE TO THE NEW ELEVATION USING NEW PIPE AND A COLLAR CASTING.
6. WHEN CAST IRON CASTINGS TO BE REMOVED REQUIRE EXCAVATION GREATER THAN 20" DEEP, CONTRACTOR MAY ELECT TO FILL EXCAVATION WITH CONTROLLED LOW STRENGTH MATERIAL TO THE UNDERSIDE OF THE CONCRETE. PAVEMENT PATCH IN LIEU OF COMPACTED BACKFILL.
7. REINFORCING STEEL SHALL MEET SPECIFICATIONS.
8. VALVE BOXES MUST BE INSTALLED IN A STRAIGHT, VERTICAL POSITION.
9. VALVE MARKERS SHALL BE INSTALLED BEHIND EACH VALVE BOX WHEN VALVE IS LOCATED WITHIN EASEMENT OR R.O.W.

NOT TO SCALE




TYPICAL IRON VALVE BOX
 DETAILS



M&S ENGINEERING
 ELECTRICAL | CIVIL | MEP
 TXENG FIRM # F-1394 | TBPELS FIRM #10169800
 WWW.MSENGR.COM | (830) 228-5446

APPROVED	REVISION
JUNE 2015	AUGUST 2018

SHEET	
1	OF 1

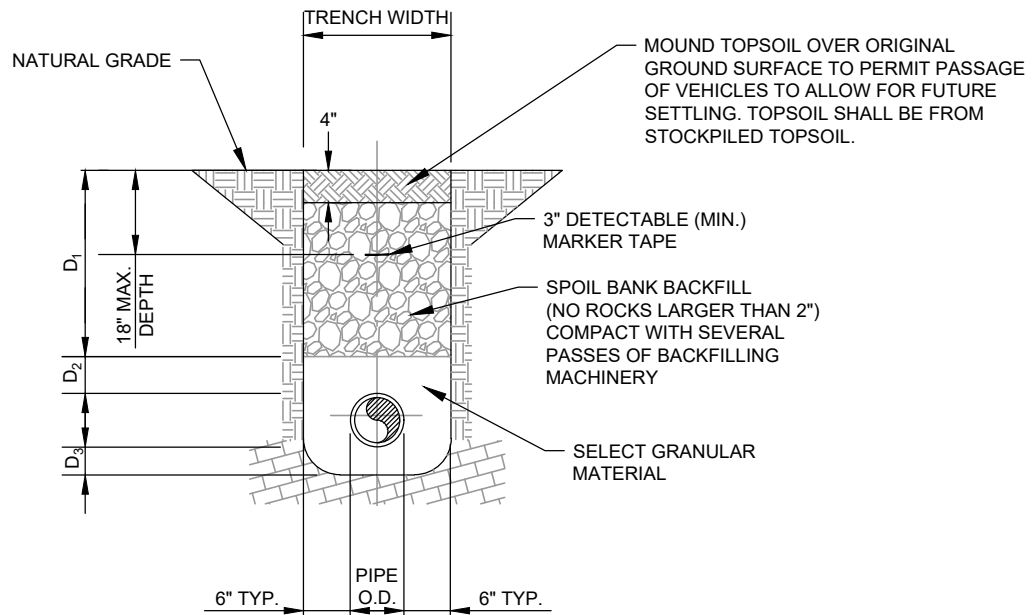

	D ₁	D ₂	D ₃
4" OR SMALLER	36"	6"	4"
6"-8"	30"	12"	6"
12" OR LARGER	42"	12"	6"



TRENCHING NOTES


1. ADEQUATE BARRICADES & WARNING SIGNS SHALL BE ERECTED BEFORE ANY WORK IS STARTED IN PUBLIC RIGHT-OF-WAY.
2. REFER TO SPECIFICATIONS FOR ANY SPECIAL REQUIREMENTS OR CONDITIONS.
3. BACKFILL SHALL BE COMPLETED IMMEDIATELY AFTER PIPELINE LAYING WITHIN PUBLIC RIGHT-OF-WAYS OR CROSSING PUBLIC RIGHT-OF-WAYS & PRIVATE DRIVEWAYS.

TRENCH SAFETY NOTES

1. TRENCH SAFETY SYSTEM, SHORING OR SIDE SLOPE TO BE IN ACCORDANCE WITH OSHA STANDARDS.
2. TRENCH SAFETY SYSTEM PLAN TO BE PROVIDED BY CONTRACTOR PRIOR TO CONSTRUCTION.

NOT TO SCALE

PROPERTY OF 	TYPICAL TRENCH BACKFILL DETAIL	 M&S ENGINEERING ELECTRICAL CIVIL MEP <small>TXENG FIRM # F-1394 TBPELS FIRM #10169800 WWW.MSENGR.COM (830) 228-5446</small>	APPROVED	REVISION
			JUNE 2015	NOV 2021
SHEET			1	OF 1

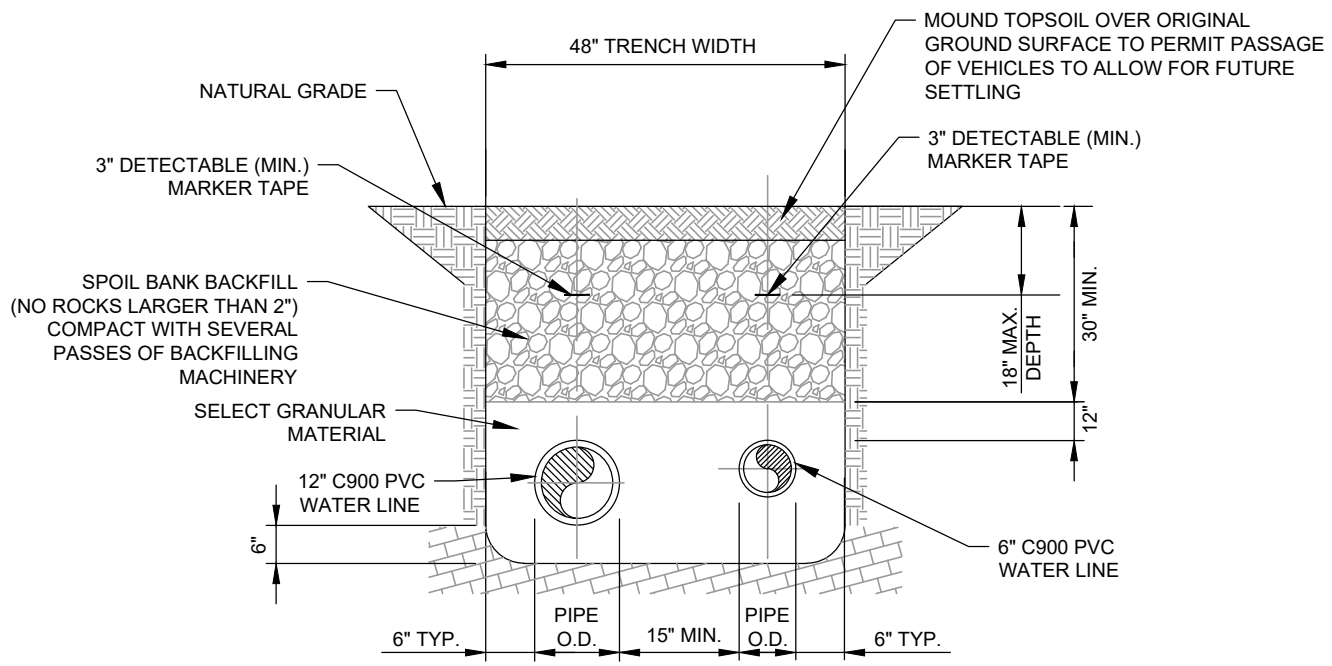

TRENCHING NOTES

1. ADEQUATE BARRICADES & WARNING SIGNS SHALL BE ERECTED BEFORE ANY WORK IS STARTED IN PUBLIC RIGHT-OF-WAY.
2. REFER TO SPECIFICATIONS FOR ANY SPECIAL REQUIREMENTS OR CONDITIONS
3. BACKFILL SHALL BE COMPLETED IMMEDIATELY AFTER PIPELINE LAYING WITHIN PUBLIC RIGHT-OF-WAYS OR CROSSING PUBLIC RIGHT-OF-WAYS & PRIVATE DRIVEWAYS.

TRENCH SAFETY NOTES

1. TRENCH SAFETY SYSTEM, SHORING OR SIDE SLOPE TO BE IN ACCORDANCE WITH OSHA STANDARDS.
2. TRENCH SAFETY SYSTEM PLAN TO BE PROVIDED BY CONTRACTOR PRIOR TO CONSTRUCTION.

NOT TO SCALE